

IntesisBox[®]

PA-RC-KNX-1i v1.0

User's Manual

Issue Date: 03/04/2012
r0 eng



© Intesis Software S.L. All Rights Reserved.

Information in this document is subject to change without notice. The software described in this document is furnished under a license agreement or nondisclosure agreement. The software may be used only in accordance with the terms of those agreements. No part of this publication may be reproduced, stored in a retrieval system or transmitted in any form or any means electronic or mechanical, including photocopying and recording for any purpose other than the purchaser's personal use without the written permission of Intesis Software S.L.

Intesis Software S.L.
Milà I Fontanals, 1 bis, 1º
08700 Igualada
Spain

TRADEMARKS

All trademarks and trade names used in this document are acknowledged to be the copyright of their respective holders.

Gateway for integration of Panasonic air conditioners into KNX TP-1 (EIB) control systems. Compatible with FS and FSM Series air conditioners commercialized by Panasonic.

Application's Program Version: 1.0

Order Code: **PA-RC-KNX-1i**

INDEX

1.	Presentation	6
2.	Connection	7
2.1	PA-RC-KNX-1i without Panasonic Remote Controller	7
2.2	PA-RC-KNX-1i with Panasonic Remote Controller	7
3.	Configuration and setup	9
4.	ETS Parameters	10
4.1	General dialog	11
4.1.1	Send READs for Control_ objects on bus recovery	11
4.1.2	Scene to load on bus recovery / startup	11
4.1.3	Disallow control from remote controller	11
4.1.4	Enable func "Control_ Lock Control Obj"	12
4.1.5	Enable func "Operating Hours Counter"	12
4.1.6	Enable use of objects for Filter	13
4.1.7	Enable object "Error Code [2byte]"	13
4.1.8	Enable object "Error Text Code [14byte]"	14
4.2	Mode Configuration dialog	14
4.2.1	Indoor unit has HEAT mode	14
4.2.2	When mode is AUTO Status_ objs report actual operating status	15
4.2.3	Enable use of Heat / Cool bit-type obj	15
4.2.4	Enable PID-Compat. Scaling Mode Objects	15
4.2.5	Enable use of + / - object for Mode	16
4.2.6	Enable use of bit-type Mode objects (for control)	17
4.2.7	Enable use of bit-type Mode objects (for status)	17
4.2.8	Enable use of Text object for Mode	17
4.3	Special Modes Configuration dialog	18
4.3.1	Enable use of POWER mode	19
4.3.2	Enable use of ECONOMY mode	20
4.3.3	Enable use of ADDITIONAL HEATING mode	20
4.3.4	Enable use of ADDITIONAL COOLING mode	21
4.4	Fan Speed Configuration dialog	22
4.4.1	When fan is AUTO Status_ objs report actual operating status (speed1/2/...)	22
4.4.2	DPT object type for fanspeed	22
4.4.3	Enable use of +/- object for Fan Speed	23
4.4.4	Enable use of bit-type Fan Speed objects (for Control)	24
4.4.5	Enable use of bit-type Fan Speed objects (for Status)	24
4.4.6	Enable use of Text object for Fan Speed	25
4.5	Vanes Up-Down Configuration dialog	25
4.5.1	Indoor unit has U-D Vanes	26
4.5.2	Available AUTOs in Indoor Unit	26
4.5.3	DPT object type for Vanes Up-Down	26
4.5.4	Enable use of +/- object for Vanes U-D	27
4.5.5	Enable "Vanes U-D Man/Auto" objects (for control and status)	28
4.5.6	Enable use of bit-type Vane U-D objects (for Control)	29
4.5.7	Enable use of bit-type Vane U-D objects (for Status)	29
4.5.8	Enable use of Text object for Vane U-D	29
4.6	Temperature Configuration dialog	30
4.6.1	Periodic sending of "Status_ AC Setp"	30
4.6.2	Enable use of +/- object for Setpoint Temp	30
4.6.3	Enable limits on Control_ Setpoint obj	31
4.6.4	Ambient temp. ref. is provided from KNX	31
4.7	Scene Configuration dialog	32
4.7.1	Enable use of scenes	33
4.7.2	Scenes can be stored from KNX bus	33

4.7.3	Enable use of bit objects for scene execution	34
4.7.4	Scene "x" preset	34
4.8	Switch-Off Timeouts Configuration dialog	36
4.8.1	Enable use of Open Window / Switch off timeout function	36
4.8.2	Enable use of Occupancy function	37
4.8.3	Enable use of SLEEP timeout	40
4.9	Binary Input "x" Configuration dialog	40
4.9.1	Enable use of Input "x"	41
4.9.2	Contact type	41
4.9.3	Debounce time	41
4.9.4	Disabling function.....	41
4.9.5	Function.....	42
5.	Specifications.....	50
6.	AC Unit Types compatibility.	51
7.	Error Codes	52
Appendix A – Communication Objects Table.....		54

1. Presentation



PA-RC-KNX-1i allows a complete and natural integration of PANASONIC air conditioners with KNX control systems.

Compatible with FS and FSM Series air conditioners commercialized by Panasonic.

Main features:

- Reduced dimensions, quick installation.
- Multiple objects for control and status (bit, byte, characters...) with KNX standard datapoint types.
- Status objects for every control available.
- Timeout for Open Window and Occupancy. Sleep function also available.
- Control of the AC unit based in the ambient temperature read by the own AC unit, or in the ambient temperature read by any KNX thermostat.
- AC unit can be controlled simultaneously by the wired remote control of the AC unit and by KNX.
- Total Control and Monitoring of the AC unit from KNX, including monitoring of AC unit's state of internal variables, running hours counter (for filter maintenance control), and error indication and error code.
- Up to 5 scenes can be saved and executed from KNX, fixing the desired combination of Operation Mode, Set Temperature, Fan Speed, Vane Position and Remote Controller Lock in any moment by using a simple switching.
- Four binary inputs for potential-free contacts provide the possibility to integrate many types of external devices. Also configurable from ETS, they can be used for switching, dimming, shutter/blind control, and more

2. Connection

Connection of the PA-RC-KNX-1i to the AC indoor unit

2.1 PA-RC-KNX-1i without Panasonic Remote Controller

The PA-RC-KNX-1i can be connected directly to the A/B bus of the indoor unit (no Panasonic remote controller -RC from now on- also connected in the A/B bus). See connection diagram below.

2.2 PA-RC-KNX-1i with Panasonic Remote Controller

If a Panasonic remote controller (RC) is present and connected to the A/B bus, this one have ALWAYS to be set up as Master:

- To check if the RC is in Master or Slave mode, it has a switch on the back. This switch should always be placed in "MASTER" position.

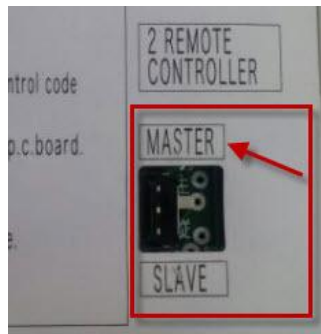


Figure 2.1 Panasonic RC PCB backside, M/S switch

Disconnect mains power from the AC unit and use a 2 wire cable with a diameter of 0.75mm^2 to 1.25mm^2 for the connection of PA-RC-KNX-1i, Panasonic remote controller and its corresponding indoor unit. Screw the suitably peeled cable ends in the corresponding X/Y terminals of each device, as summarized in the **Figure 2.2**.

Maximum A/B bus length is 200 meter. Cable has no polarity.


Connection of the PA-RC-KNX-1i to the KNX bus:

Disconnect power of the KNX bus. Connect the PA-RC-KNX-1i to the KNX TP-1 (EIB) bus using the KNX standard connector (red/grey) of the PA-RC-KNX-1i, respect polarity.

Reconnect power of the KNX bus, and mains power of the AC unit.

Connection diagrams:

PA-RC-KNX-1i without Panasonic RC

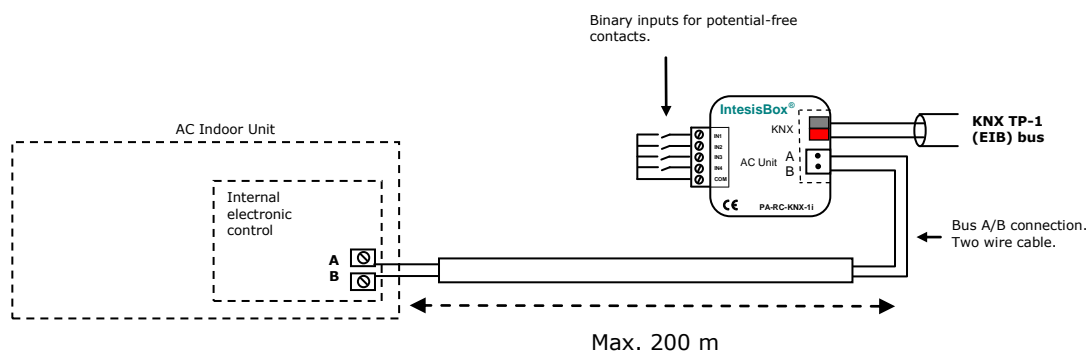

PA-RC-KNX-1i with Panasonic RC

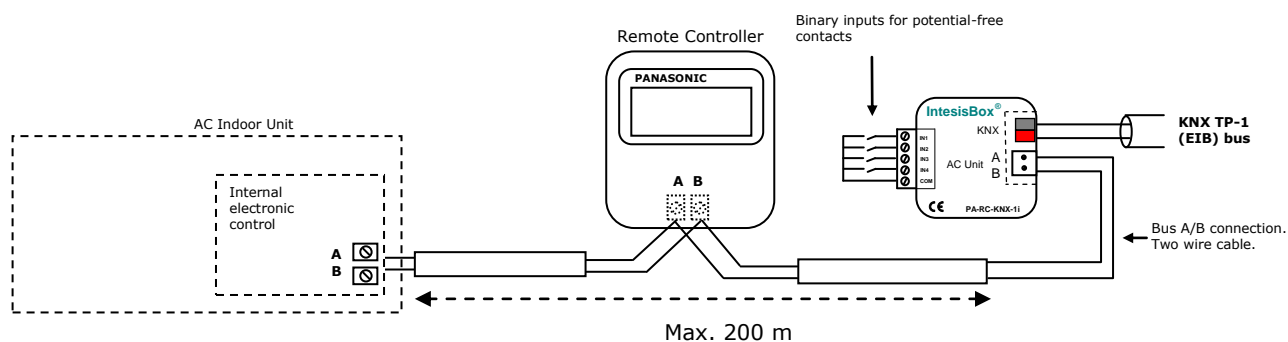


Figure 2.2 PA-RC-KNX-1i connection diagrams

3. Configuration and setup

This is a fully compatible KNX device which must be configured and setup using standard KNX tool ETS.

ETS database for this device can be downloaded from:

<http://www.intesis.com/download/eib/PA-RC-KNX-1i.zip>

Please consult the README.txt file, located inside the downloaded zip file, to find instructions on how to install the database.

⚠ Important: Do not forget to select the correct settings of AC indoor unit being connected to the PA-RC-KNX-1i. This is in "Parameters" of the device in ETS.

4. ETS Parameters

When imported to the ETS software for the first time, the gateway shows the following default parameter configuration:

Device: 1.1.1 PA RC Interface

General

- Mode Configuration
- Special Modes Configuration
- Fan Speed Configuration
- Vanes Up-Down Configuration
- Temperature Configuration
- Scene Configuration
- Switch-Off Timeouts Configuration
- Binary Input 1 Configuration
- Binary Input 2 Configuration
- Binary Input 3 Configuration
- Binary Input 4 Configuration

Download latest database entry for this product and its User Manual from:

Send READs for Control_ objects on bus recovery (T & U flags must be active):

> Delay before sending READs (sec):

Scene to load on bus recovery / startup (needs to define vals for that scene):

Disallow control from remote controller:

> Enable comm obj "Ctrl_ Remote Lock":

Enable func "Control_ Lock Control Obj":

Enable func "Operating Hours Counter":

Enable use of objects for Filter (for Control and Status):

Enable object "Error Code [2byte]":

Enable object "Error Text Code [14byte]" (3 ASCII-char Error Code):

Figure 4.1 Default parameter configuration

With this configuration it's possible to send On/Off (*Control_ On/Off*), change the AC Mode (*Control_ Mode*), the Fan Speed (*Control_ Fan Speed*) and also the Setpoint Temperature (*Control_ Setpoint Temperature*). The Status_ objects, for the mentioned Control_ objects, are also available to use if needed. Also objects *Status_ AC Return Temp* and *Status_ Error/Alarm* are shown.

- 1.1.1 PA RC Interface
 - 0: Control_ On/Off [DPT_1.001 - 1bit] - 0-Off;1-On
 - 1: Control_ Mode [DPT_20.105 - 1byte] - 0-Aut;1-Hea;3-Coo;9-Fan;14-Dry
 - 10: Control_ Mode +/- [DPT_1.007 - 1bit] - 0-Decrease;1-Increase
 - 11: Control_ Fan Speed / 3 Speeds [DPT_5.010 - 1byte] - Speed values: 1,2,3
 - 17: Control_ Vanes U-D / 4 Pos [DPT_5.010 - 1byte] - Position values: 1,2,3,4
 - 26: Control_ Setpoint Temperature [DPT_9.001 - 2byte] - (°C)
 - 39: Control_ Execute Scene [DPT_18.001 - 1byte] - 0.4-Execute Scene 1-5
 - 54: Status_ On/Off [DPT_1.001 - 1bit] - 0-Off;1-On
 - 55: Status_ Mode [DPT_20.105 - 1byte] - 0-Aut;1-Hea;3-Coo;9-Fan;14-Dry
 - 63: Status_ Fan Speed / 3 Speeds [DPT_5.010 - 1byte] - Speed Values: 1,2,3
 - 69: Status_ Vanes U-D / 4 Pos [DPT_5.010 - 1byte] - Position values: 1,2,3,4
 - 78: Status_ AC Setpoint Temp [DPT_9.001 - 2byte] - (°C)
 - 80: Status_ Error/Alarm [DPT_1.005 - 1bit] - 0-No alarm;1-Alarm
 - 88: Status_ Current Scene [DPT_17.001 - 1byte] - 0.4-Scene X+1;63-No Scene

Figure 4.2 Default communication objects

4.1 General dialog

Inside this parameter's dialog it is possible to activate or change the parameters shown in the **Figure 4.1**.

The first field shows the URL where to download the database and the user manual for the product.

4.1.1 Send READs for Control_ objects on bus recovery

When this parameter is enabled, PA-RC-KNX-1i will send READ telegrams for the group addresses associated on its *Control_* objects on bus recovery or application reset/start-up.

- If set to **"no"** the gateway will not perform any action.
- If set to **"yes"** all *Control_* objects with both Transmit **(T)** and Update **(U)** flags enabled will send READs and their values will be updated with the response when received.

Send READs for Control_ objects on bus recovery (T and U flags must be active)

> Delay before sending READs (sec)

Figure 4.3 Parameter detail

➤ Delay before sending READs (sec):

With this parameter, a delay can be configured between 0 and 30 seconds for the READs sent by the *Control_* objects. This is to give time enough to other KNX devices on the bus to start-up before sending the READs.

4.1.2 Scene to load on bus recovery / startup

This parameter executes a selected scene on bus recovery or startup, only if the selected scene has an enabled preset or values previously saved from KNX bus (see Scene Configuration dialog).

If the gateway is disconnected from the indoor unit the scene will not be applied, even when connecting to the indoor unit again.

Scene to load on bus recovery / startup (needs to define vals for that scene)

Figure 4.4 Parameter detail

4.1.3 Disallow control from remote controller

This parameter allows:

- 1- Having the remote controller always locked, or
 - 2- Decide through a new communication object if the RC is locked or not.
- If set to **"yes"** all the actions performed through the remote controller will be disabled.

- If set to “no” the remote controller will work as usually. It also appears a new parameter and the communication object *Control_ Lock Remote Control*.

■ 33 Control_ Lock Remote Control [DPT_1.002 - 1bit] - 0-Unlocked;1-Locked

Disallow control from remote controller	no
> Enable comm obj "Ctrl_ Remote Lock"	yes

Figure 4.5 Communication object and parameter detail

➤ Enable comm obj “Ctrl_ Remote Lock”:

If set to “no” the object will not be shown.

If set to “yes” the *Control_ Lock Remote Control* object will appear.

- When a “1” value is sent to this communication object, the remote controller is locked. To be unlocked a “0” value must be sent. The gateway remembers the last value received even if a KNX bus reset/failure happens.

⚠ Important: *If an initial scene is enabled and it has as Value for Remote Lock (unchanged) or unlocked, this would unlock the remote controller because the initial scene has priority over the Control_ Lock Remote Control communication object.*

4.1.4 Enable func “Control_ Lock Control Obj”

This parameter shows/hide the *Control_ Lock Control Obj* communication object which, depending on the sent value, locks or unlocks ALL the *Control_* communication objects except itself.

■ 34 Control_ Lock Control Objects [DPT_1.002 - 1bit] - 0-Unlocked;1-Locked

- If set to “no” the object will not be shown.
- If set to “yes” the *Control_ Lock Control Objects* object will appear.
 - When a “1” value is sent to this communication object, all the *Control_* objects will be locked. To unlock a “0” value must be sent, as the gateway remembers the last value received even if a KNX bus reset/failure happens.

4.1.5 Enable func “Operating Hours Counter”

This parameter shows/hides the *Status_ Operation Hour Counter* communication object which counts the number of operating hours for the PA-RC-KNX-1i.



■ 87 Status_ Operation Hour Counter [DPT_7.001 - 2byte] - Number of operating hours

- If set to “no” the object will not be shown.

- If set to **"yes"** the *Status_ Operation Hour Counter* object will appear.
 - This object can be read and sends its status every time an hour is counted. The gateway keeps that count in memory and the status is sent also after a KNX bus reset/failure. Although this object is marked as a *Status_* object it also can be written to update the counter when needed. To reset the counter should be written a **"0"** value.
 - ⚠ **Important:** This object comes by default without the write (**W**) flag activated. If is necessary to write on it, this flag must be activated.
 - ⚠ **Important:** This object will also return its status, every time a value is written, only if it's different from the existing one.
 - ⚠ **Important:** If the stored value is 0 hours, the gateway will not send the status to KNX.

4.1.6 Enable use of objects for Filter


This parameter shows/hides *Control_ Reset Filter* and *Status_ Filter Status* that lets reset the filter status and also monitor if there is a filter alarm.

 29 *Control_ Reset Filter* [DPT_1.015 - 1bit] - 1-Reset filter
 79 *Status_ Filter Status* [DPT_1.005 - 1bit] - 0-No alarm;1-Alarm

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Control_ Reset Filter* y *Status_ Filter Status* objects will appear.
 - The *Status_* object will show a **"0"** value when there's no filter alarm, and a **"1"** value when the filter is full. Once the filter is cleaned, the alarm can be reset by sending a **"1"** value to the *Control_ Reset Filter* object.

4.1.7 Enable object "Error Code [2byte]"

This parameter shows/hides the *Status_ Error Code* communication object which shows the indoor unit errors, if occurred, in numeric format.

 81 *Status_ Error Code* [2byte] - 0-No error /Any other see man.

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Status_ Error Code* [2byte] object will appear.
 - This object can be read and also sends the indoor unit error, if occurred, in numeric format. If a **"0"** value is shown that means no error.

4.1.8 Enable object “Error Text Code [14byte]”

This parameter shows/hides the *Status_ Error Text Code* communication object which shows the indoor unit errors, if occurred, in text format.

✚ 82 Status_ Error Text Code [DPT_16.001 - 14byte] - 3-char MH Error; Empty-None

- If set to **“no”** the object will not be shown.
- If set to **“yes”** the *Status_ Error Text Code* object will appear.
 - This object can be read and also sends the indoor unit error, if occurred, in text format. The errors shown have the same format as at the remote controller and at the error list from the indoor unit manufacturer. If the object's value is empty that means no error.

4.2 Mode Configuration dialog

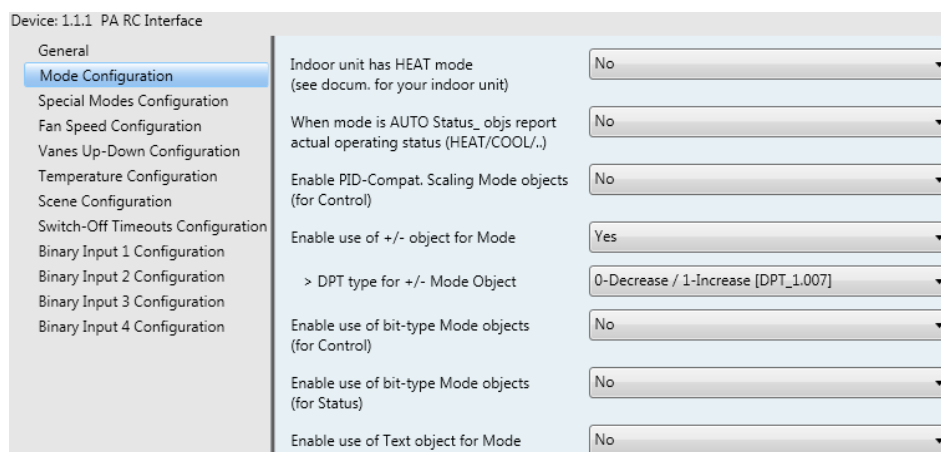


Figure 4.6 Default Mode Configuration dialog

All the parameters in this section are related with the different mode properties and communication objects.

✚ 1 Control_ Mode [DPT_20.105 - 1byte] - 0-Aut;1-Hea;3-Coo;9-Fan;14-Dry

The byte-type communication object for Mode works with the DPT_20.105. Auto mode will be enabled with a **“0”** value, Heat mode with a **“1”** value, Cool mode with a **“3”** value, Fan mode with a **“9”** value and Dry mode with a **“14”** value.

4.2.1 Indoor unit has HEAT mode

This parameter has to be used to indicate if the indoor unit has the *heat mode* available.

- If set to **“no”**, the indoor unit doesn't have the *heat mode* available.
- If set to **“yes”**, the indoor unit has the *heat mode* available.

⚠ **Important:** Read the documentation of your indoor unit to check if it has HEAT mode available.

4.2.2 When mode is AUTO Status_ objs report actual operating status

This parameter shows the real status of the indoor unit when Auto mode is enabled.

- If set to **"no"**, when the indoor unit is set to Auto mode, all the *Status_* objects concerning mode will only show Auto enabled.
- If set to **"yes"**, when the indoor unit is set to Auto mode, all the *Status_* objects concerning mode will show the real mode which the machine is working (Cool, Heat, Dry, Fan). In case of the bitfield objects, also the *Status_ Mode Auto* will be shown enabled with a **"1"** value.

4.2.3 Enable use of Heat / Cool bit-type obj

This parameter shows/hides the *Control_* and *Status_ Mode Cool/Heat* communication objects.

```

■ 2 Control_ Mode Cool/Heat [DPT_1.100 - 1bit] - 0-Cool;1-Heat
■ 56 Status_ Mode Cool/Heat [DPT_1.100 - 1bit] - 0-Cool;1-Heat

```

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Control_* and *Status_ Mode Cool/Heat* objects will appear.
 - When a **"1"** value is sent to the *Control_* communication object, **Heat mode** will be enabled in the indoor unit, and the *Status_* object will return this value.
 - When a **"0"** value is sent to the *Control_* communication object, **Cool mode** will be enabled in the indoor unit, and the *Status_* object will return this value.

4.2.4 Enable PID-Compat. Scaling Mode Objects

This parameter shows/hides the *Control_ Mode Cool & On* and *Control_ Mode Heat & On* communication objects.

```

■ 3 Control_ Mode Cool & On [DPT_5.001 - 1byte] - 0%-Off;0.1%-100%-On+Cool
■ 4 Control_ Mode Heat & On [DPT_5.001 - 1byte] - 0%-Off;0.1%-100%-On+Heat

```

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Control_ Mode Cool & On* and *Control_ Mode Heat & On* objects will appear.
 - These objects provide compatibility with those KNX thermostats that control the demand of heating or cooling by using scaling (percentage) objects. In

these thermostats, the percentage demand is meant to be applied on a fluid valve of the heating / cooling system.

- PA-RC-KNX-1i device does not provide individual control on the internal parts of the indoor unit (as can be its compressor, refrigerant valves, etc). Rather, it provides the same level of control as a (user) remote controller.
- Objects "Control_ Mode Cool & On" and "Control_ Mode Heat & On" intend to bring compatibility between thermostats oriented to the control of custom heating / cooling systems and ready-made AC indoor units, by applying the following logic:
 - Whenever a non-zero value (>0%) is received at "Control_ Mode Cool & On", indoor unit will switch On in COOL mode.
 - Whenever a non-zero value (>0%) is received at "Control_ Mode Heat & On", indoor unit will switch On in HEAT mode.
 - Lastest updated object will define the operating mode
 - Indoor unit will switch off only when both objects become zero (0%) – or when an OFF is requested at object "0. On/Off [DPT_1.001 - 1bit]"

* **Important:** These objects function is only to send On/Off and Cool/Heat to the indoor unit. The PID (Inverter system) is calculated by the indoor unit itself. Please consider introducing an appropriate PID configuration to the external KNX thermostat to not interfere the indoor unit PID.

4.2.5 Enable use of + / - object for Mode

This parameter shows/hides the *Control_ Mode* +/- communication object which lets change the indoor unit mode by using two different datapoint types.

■ 10 Control_ Mode +/- [DPT_1.007 - 1bit] - 0-Decrease;1-Increase

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Control_ Mode* +/- object and a new parameter will appear.

Enable use of +/- object for Mode	yes
> DPT type for +/- Mode Object	0-Up / 1-Down [DPT_1.008]

Figure 4.7 Parameter detail

➤ DPT type for +/- Mode Object

This parameter lets choose between the datapoints **0-Up / 1-Down [DPT_1.008]** and **0-Decrease / 1-Increase [DPT_1.007]** for the *Control_ Mode* +/- object.

The sequence followed when using this object is shown below:



- Up / Increase
- Down / Decrease
- * If available

⚠ Important: Read the documentation of your indoor unit to check if it has HEAT mode available.

4.2.6 Enable use of bit-type Mode objects (for control)

This parameter shows/hides the bit-type *Control_ Mode* objects.

- 5 Control_ Mode Auto [DPT_1.002 - 1bit] - 1-Set AUTO mode
- 6 Control_ Mode Heat [DPT_1.002 - 1bit] - 1-Set HEAT mode
- 7 Control_ Mode Cool [DPT_1.002 - 1bit] - 1-Set COOL mode
- 8 Control_ Mode Fan [DPT_1.002 - 1bit] - 1-Set FAN mode
- 9 Control_ Mode Dry [DPT_1.002 - 1bit] - 1-Set DRY mode

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Control_ Mode* objects for Auto, Heat, Cool, Fan and Dry will appear. To activate a mode by using these objects a **"1"** value has to be sent.

4.2.7 Enable use of bit-type Mode objects (for status)

This parameter shows/hides the bit-type *Status_ Mode* objects.

- 57 Status_ Mode Auto [DPT_1.002 - 1bit] - 1-AUTO mode is active
- 58 Status_ Mode Heat [DPT_1.002 - 1bit] - 1-HEAT mode is active
- 59 Status_ Mode Cool [DPT_1.002 - 1bit] - 1-COOL mode is active
- 60 Status_ Mode Fan [DPT_1.002 - 1bit] - 1-FAN mode is active
- 61 Status_ Mode Dry [DPT_1.002 - 1bit] - 1-DRY mode is active

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Status_ Mode* objects for Auto, Heat, Cool, Fan and Dry will appear. When enabled, a mode will return a **"1"** through its bit-type object.

4.2.8 Enable use of Text object for Mode

This parameter shows/hides the *Status_ Mode Text* communication object.

62 Status_ Mode Text [DPT_16.001 - 14byte] - ASCII String

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Status_ Mode Text* object will appear. Also, in the parameters, will be shown five text fields, one for each mode, that will let modify the text string displayed by the *Status_ Mode Text* when changing mode.

> String when mode is AUTO	AUTO
> String when mode is HEAT (if available)	HEAT
> String when mode is COOL	COOL
> String when mode is FAN	FAN
> String when mode is DRY	DRY

Figure 4.8 Parameter detail

4.3 Special Modes Configuration dialog

Device: 1.1.1 PA RC Interface

General	Enable use of POWER mode	No
Mode Configuration	Enable use of ECONOMY mode	No
Special Modes Configuration	Enable use of ADDITIONAL HEATING mode	No
Fan Speed Configuration	Enable use of ADDITIONAL COOLING mode	No
Vanes Up-Down Configuration		
Temperature Configuration		
Scene Configuration		
Switch-Off Timeouts Configuration		
Binary Input 1 Configuration		
Binary Input 2 Configuration		
Binary Input 3 Configuration		
Binary Input 4 Configuration		

Figure 4.9 Default Special Modes Configuration dialog

The Special Modes can be parameterized through the ETS parameters dialog, and they can be used to give extra functionality.

- ⚠ **Important:** When executing any of the Special Modes the real state of the indoor unit will NOT be shown in KNX.
- ⚠ **Important:** When the predefined time for the Special Mode is finished or a **"0"** value is sent to stop it, the previous state will be recovered.
- ⚠ **Important:** If a value concerning On/Off, Mode, Fan Speed or Setpoint Temperature is received from KNX while any Special Mode is running (**"1"**), the Special Mode will stop and the previous state will be recovered. The value received will be also applied then.
- ⚠ **Important:** If a value concerning On/Off, Mode, Fan Speed or Setpoint Temperature is modified through the remote controller, the Special Mode will stop WITHOUT recovering the previous state. Then the real indoor unit state will be shown in KNX including the new value received through the remote controller.

4.3.1 Enable use of POWER mode

This parameter shows/hides the *Control_ Power Mode* and *Status_ Power Mode* communication objects. The Power Mode lets change the Setpoint Temperature and the Fan Speed within a given period of time.

- 35 Control_ Power Mode [DPT_1.010 - 1bit] - 0-Stop;1-Start
- 83 Status_ Power Mode [DPT_1.001 - 1bit] - 0-Off;1-On

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Control_ Power Mode* and *Status_ Power Mode* objects and new parameters will appear.

Figure 4.10 Parameter detail

- When a **"1"** value is sent to the *Control_* communication object Power Mode will be enabled, and the *Status_* object will return this value.
- When a **"0"** value is sent to the *Control_* communication object, Power Mode will be disabled, and the *Status_* object will return this value.

⚠ Important: This mode will **ONLY** work if the indoor unit is both turned on and in a Heat, Cool, Auto-Heat or Auto-Cool Mode.

➤ Action time for this mode (minutes):

Duration of Power Mode, in minutes, once started.

➤ Setpoint delta increase (HEAT) or decrease (COOL) – in Celsius:

Number of degrees Celsius that will increase in Heat Mode, or decrease in Cool Mode, while in Power Mode.

➤ Fan Speed for this mode:

Fan Speed that will be set in the unit while in Power Mode.

4.3.2 Enable use of ECONOMY mode

This parameter shows/hides the *Control_ Econo Mode* and *Status_ Econo Mode* communication objects. The Econo Mode lets change the Setpoint Temperature and the Fan Speed within a given period of time.

- ↕ 36 Control_ Econo Mode [DPT_1.010 - 1bit] - 0-Stop;1-Start
- ↕ 84 Status_ Econo Mode [DPT_1.001 - 1bit] - 0-Off;1-On

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Control_ Econo Mode* and *Status_ Econo Mode* objects and new parameters will appear.
 - When a **"1"** value is sent to the *Control_* communication object, EconoMode will be enabled, and the *Status_* object will return this value.
 - When a **"0"** value is sent to the *Control_* communication object, EconoMode will be disabled, and the *Status_* object will return this value.

⚠ Important: This mode will ONLY work if the indoor unit is both turned on and in a Heat, Cool, Auto-Heat or Auto-Cool Mode.

➤ Action time for this mode (minutes):

Duration of EconoMode, in minutes, once started.

➤ Setpoint delta increase (HEAT) or decrease (COOL) – in Celsius:

Number of degrees Celsius that will increase in Heat Mode, or decrease in Cool Mode, while in EconoMode.

➤ Fan Speed for this mode:

Fan Speed that will be set in the unit while in EconoMode.

4.3.3 Enable use of ADDITIONAL HEATING mode

This parameter shows/hides the *Control_ Start Additional Heat Mode* and *Status_ Additional Heat Mode* communication objects. The Additional Heating Mode lets change the Setpoint Temperature and the Fan Speed within a given period of time.

- ↕ 37 Control_ Additional Heat [DPT_1.010 - 1bit] - 0-Stop;1-Start
- ↕ 85 Status_ Additional Heat [DPT_1.001 - 1bit] - 0-Off;1-On

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Control_ Start Additional Heat Mode* and *Status_ Additional Heat Mode* objects and new parameters will appear.

- When a "1" value is sent to the *Control_* communication object, Additional Heating Mode will be enabled, and the *Status_* object will return this value.
- When a "0" value is sent to the *Control_* communication object, Additional Heating Mode will be disabled, and the *Status_* object will return this value.

⚠ Important: *This mode will ALWAYS turn on the indoor unit in Heat mode.*

➤ Action time for this mode (minutes):

Duration of Additional Heating Mode, in minutes, once started.

➤ Setpoint temp for this mode (°C):

Setpoint temperature that will be applied while in Additional Heating Mode.

➤ Fan Speed for this mode:

Fan Speed that will be set in the unit while in Additional Heating Mode.

4.3.4 Enable use of ADDITIONAL COOLING mode

This parameter shows/hides the *Control_ Start Additional Cool Mode* and *Status_ Additional Cool Mode* communication objects. The Additional Heating Mode lets change the Setpoint Temperature and the Fan Speed within a given period of time.

■ 38 *Control_ Additional Cool* [DPT_1.010 - 1bit] - 0-Stop;1-Start
 ■ 86 *Status_ Additional Cool* [DPT_1.001 - 1bit] - 0-Off;1-On

- If set to "no" the objects will not be shown.
- If set to "yes" the *Control_ Start Additional Cool Mode* and *Status_ Additional Cool Mode* objects and new parameters will appear.
 - When a "1" value is sent to the *Control_* communication object, Additional Cooling Mode will be enabled, and the *Status_* object will return this value.
 - When a "0" value is sent to the *Control_* communication object, Additional Cooling Mode will be disabled, and the *Status_* object will return this value.

⚠ Important: *This mode will ALWAYS turn on the indoor unit in Cool mode.*

➤ Action time for this mode (minutes):

Duration of Additional Cooling Mode, in minutes, once started.

➤ Setpoint temp for this mode (°C):

Setpoint temperature that will be applied while in Additional Cooling Mode.

➤ Fan Speed for this mode:

Fan Speed that will be set in the unit while in Additional Cooling Mode.

4.4 Fan Speed Configuration dialog

Figure 4.11 Default Fan Speed Configuration dialog

All the parameters in this section are related with the Fan Speed properties and communication objects.

4.4.1 When fan is AUTO Status_ objs report actual operating status (speed1/2/...)

This parameter shows the real fan status of the indoor unit when Auto fan mode is enabled.

- If set to **"no"**, when the indoor unit is set to fan Auto mode, all the *Status_* objects concerning fan will only show Auto enabled.
- If set to **"yes"**, when the indoor unit is set to fan Auto mode, all the *Status_* objects concerning mode will show the real fan mode which the machine is working (Speed 1, Speed 2, etc). In case of the bitfield objects, also the *Status_ Fan Speed Manual/Auto* will be shown enabled with a **"1"** value.

Figure 4.12 Parameter detail

4.4.2 DPT object type for fanspeed

With this parameter is possible to change de DPT for the *Control_ Fan Speed* and *Status_ Fan Speed* byte-type communication objects. Datapoints Scaling (DPT_5.001) and Enumerated (DPT_5.010) can be selected.

⚠ Important: The communication objects shown in this section may be different depending on the number of fan speeds available, although they all share the same communication object number.

- When **"Enumerated [DPT 5.010]"** is selected, *Control_ Fan Speed* and *Status_ Fan Speed* communication objects for this DPT will appear.

- 11 Control_ Fan Speed / 3 Speeds [DPT_5.010 - 1byte] - Speed values: 1,2,3
- 63 Status_ Fan Speed / 3 Speeds [DPT_5.010 - 1byte] - Speed Values: 1,2,3

The first fan speed will be selected if a **"1"** is sent to the *Control_* object. The second one will be selected sending a **"2"**; the third one will be selected sending a **"3"**.

The *Status_* object will always return the value for the fan speed selected.

⚠ Important: If a **"0"** value is sent to the *Control_* object, the minimum fan speed will be selected. If a value bigger than **"3"** is sent to the *Control_* object, then the maximum fan speed will be selected.

- When **"Scaling [DPT 5.001]"** is selected, *Control_ Fan Speed* and *Status_ Fan Speed* communication objects for this DPT will appear.

- 11 Control_ Fan Speed / 3 Speeds [DPT_5.001 - 1byte] - Thresholds: 50% and 83%
- 63 Status_ Fan Speed / 3 Speeds [DPT_5.001 - 1byte] - 33%, 67% and 100%

The next table shows the range of values that can be sent through the *Control_* object and the value returned by the *Status_* object.

	Fan Speed 1	Fan Speed 2	Fan Speed 3
Control_	0% - 49%	50% - 82%	83% - 100%
Status_	33%	67%	100%

⚠ Important: Read the documentation of your indoor unit to check how many fan speeds are available.

4.4.3 Enable use of +/- object for Fan Speed

This parameter shows/hides the *Control_ Fan Speed +/-* communication object which lets increase/decrease the indoor unit fan speed by using two different datapoint types.

- 16 Control_ Fan Speed +/- [DPT_1.007 - 1bit] - 0-Decrease;1-Increase

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Control_ Fan Speed +/-* object and a new parameter will appear.

Enable use of +/- object for Fan Speed	Yes
> DPT type for +/- Fan Speed object	0-Decrease / 1-Increase [DPT_1.007]
> Rollover Speed at upper/lower limit (when controlling with +/- obj)	Yes


Figure 4.13 Parameter detail

➤ DPT type for +/- Fan Speed Object

This parameter lets choose between the datapoints **0-Up / 1-Down [DPT_1.008]** and **0-Decrease / 1-Increase [DPT_1.007]** for the *Control_ Fan Speed +/-* object.

➤ Roll-over Speed at upper/lower limit

This parameter lets choose if roll-over will be enabled ("**yes**") or disabled ("**no**") for the *Control_ Fan Speed +/-* object.

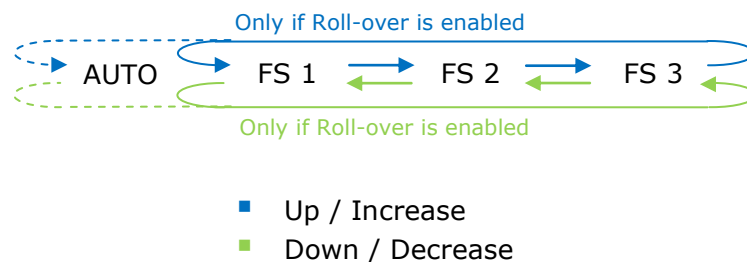

4.4.4 Enable use of bit-type Fan Speed objects (for Control)

This parameter shows/hides the bit-type *Control_ Fan Speed* objects.

- 13 Control_ Fan Speed 1 [DPT_1.002 - 1bit] - 1-Set Fan Speed 1
- 14 Control_ Fan Speed 2 [DPT_1.002 - 1bit] - 1-Set Fan Speed 2
- 15 Control_ Fan Speed 3 [DPT_1.002 - 1bit] - 1-Set Fan Speed 3

- If set to "**no**" the objects will not be shown.
- If set to "**yes**" the *Control_ Fan Speed* objects for Speed 1, Speed 2 and Speed 3 will appear. To activate a Fan Speed by using these objects a "**1**" value has to be sent.

4.4.5 Enable use of bit-type Fan Speed objects (for Status)

This parameter shows/hides the bit-type *Status_ Fan Speed* objects.

- 65 Status_ Fan Speed 1 [DPT_1.002 - 1bit] - 1-Fan in Speed 1
- 66 Status_ Fan Speed 2 [DPT_1.002 - 1bit] - 1-Fan in Speed 2
- 67 Status_ Fan Speed 3 [DPT_1.002 - 1bit] - 1-Fan in Speed 3

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Status_ Fan Speed* objects for Speed 1, Speed 2 and Speed 3 will appear. When a Fan Speed is enabled, a **"1"** value is returned through its bit-type object.

4.4.6 Enable use of Text object for Fan Speed

This parameter shows/hides the *Status_ Fan Speed Text* communication object.

68 Status_ Fan Speed Text [DPT_16.001 - 14byte] - ASCII String

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Status_ Fan Speed Text* object will appear. Also, in the parameters, will be shown five text fields, one for each Fan Speed, that will let modify the text string displayed by the *Status_ Fan Speed Text* when changing a fan speed.

> String when fan speed is AUTO	AUTO
> String when fan speed is 1	SPEED 1
> String when fan speed is 2	SPEED 2
> String when fan speed is 3	SPEED 3

Figure 4.14 Parameter detail

4.5 Vanes Up-Down Configuration dialog

Device: 1.1.1 PA RC Interface

General	Indoor unit has U-D Vanes (see docum. for your indoor unit)	Yes
Mode Configuration	Available AUTOs in Indoor Unit (see docum. for your indoor unit)	3
Special Modes Configuration	DPT object type for Vanes Up-Down	Enumerated [DPT_5.010]
Fan Speed Configuration	Enable use of +/- object for Vanes U-D	No
Vanes Up-Down Configuration	Enable "Vanes U-D Man/Auto" objects (for Control and Status)	No
Temperature Configuration	Enable use of bit-type Vanes U-D objects (for Control)	No
Scene Configuration	Enable use of bit-type Vanes U-D objects (for Status)	No
Switch-Off Timeouts Configuration	Enable use of Text object for Vanes U-D	No
Binary Input 1 Configuration		
Binary Input 2 Configuration		
Binary Input 3 Configuration		
Binary Input 4 Configuration		

Figure 4.15 Vanes Up-Down Configuration dialog

All the parameters in this section are related with the Vanes Up-Down properties and communication objects.

4.5.1 Indoor unit has U-D Vanes

This parameter lets choose if the unit has Up-Down Vanes available or not.




Figure 4.16 Parameter detail

- If set to **"no"** all the parameters and communication objects for the Up-Down Vanes will not be shown.
- If set to **"yes"** all the parameters and communication objects (if enabled in the parameters dialog) for the Up-Down Vanes will be shown.

⚠ Important: Read the documentation of your indoor unit to check if Up-Down Vanes are available.

4.5.2 Available AUTOs in Indoor Unit

This parameter lets choose if the indoor unit has only 1 AUTO mode or 3 different AUTO modes.



Figura 4.17 Detalle del parámetro

⚠ Important: Read the documentation of your indoor unit to check how many AUTO modes are available.

4.5.3 DPT object type for Vanes Up-Down

With this parameter is possible to change de DPT for the *Control_ Vanes U-D* and *Status_ Vanes U-D* byte-type communication objects. Datapoints Scaling (DPT_5.001) and Enumerated (DPT_5.010) can be selected.

⚠ Important: The communication objects shown in this section may be different depending on the number of vanes position available, although they all share the same communication object number.

- When **"Enumerated [DPT 5.010]"** is selected, *Control_ Vanes U-D* and *Status_ Vanes U-D* communication objects for this DPT will appear.

➡ 17 Control_ Vanes U-D / 4 Pos [DPT_5.010 - 1byte] - Position values: 1,2,3,4
 ➡ 69 Status_ Vanes U-D / 4 Pos [DPT_5.010 - 1byte] - Position values: 1,2,3,4

To choose a vanes position, values from **"1"** to **"4"** can be sent to the *Control_* object. Each value will correspond to the position (i.e. Value **"3"** = Position 3).

The *Status_* object will always return the value for the vane position selected.

⚠ Important: If a "0" value is sent to the *Control_* object, the Position 1 will be selected. If a value bigger than "4" is sent to the *Control_* object, then the higher Position will be selected.

- When **"Scaling [DPT 5.001]"** is selected, *Control_ Vane Up-Down* and *Status_ Vane Up-Down* communication objects for this DPT will appear.

- 17 *Control_ Vanes U-D / 4 Pos [DPT_5.001 - 1byte]* - Thresholds: 38%, 63% and 88%
- 69 *Status_ Vanes U-D / 4 Pos [DPT_5.001 - 1byte]* - 25%, 50%, 75% and 100%

The next table shows the range of values that can be sent through the *Control_* object and the value returned by the *Status_* object.

	Vanes Pos.1	Vanes Pos.2	Vanes Pos.3	Vanes Pos.4
<i>Control_</i>	0% - 37%	38% - 62%	63% - 87%	88% - 100%
<i>Status_</i>	25%	50%	75%	100%

4.5.4 Enable use of +/- object for Vanes U-D

This parameter shows/hides the *Control_ Vane Up-Down +/-* communication object which lets change the indoor unit vane position by using two different datapoint types.

- 25 *Control_ Vanes U-D +/- [DPT_1.007 - 1bit]* - 0-Decrease;1-Increase

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Control_ Vanes U-D +/-* object and a new parameter will appear.

Enable use of +/- object for Vanes U-D	Yes
> DPT type for +/- Vanes U-D object	0-Decrease / 1-Increase [DPT_1.007]
> Does +/- sequence include AUTO vanes Up-Down?	No
> Rollover Vanes at upper/lower limit (when controlling with +/- obj)	Yes

Figure 4.17 Parameter detail

➤ DPT type for +/- Vane Up-Down obj


This parameter lets choose between the datapoints **0-Up / 1-Down [DPT_1.008]** and **0-Decrease / 1-Increase [DPT_1.007]** for the *Control_ Vanes U-D +/-* object.

➤ Does +/- sequence include AUTO vanes Up-Down?

This parameter lets choose if AUTO function is included ("**yes**") or not ("**no**") in the sequence when using *Control_ Vanes U-D +/-* object as shown in the discontinuous segment at the picture below.

➤ Roll over Vanes at upper/lower limit

This parameter lets choose if roll-over will be enabled ("**yes**") or disabled ("**no**") for the *Control_ Vanes U-D +/-* object.

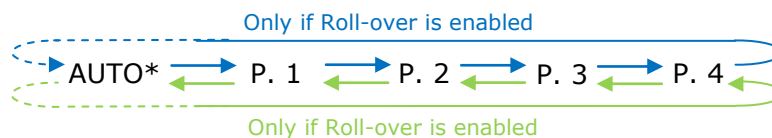

- Up / Increase
- Down / Decrease
- * If Available

4.5.5 Enable "Vanes U-D Man/Auto" objects (for control and status)

This parameter shows/hides *Control_ Vanes U-D Man/Auto* y *Status_ Vanes U-D Man/Auto* communication objects. These objects can be different depending on the number of Auto's available in the indoor unit.

- 18 Control_ Vanes U-D Man/Auto [DPT_1.002 - 1bit] - 0-Manual; 1-Auto
- 19 Control_ Vanes U-D Man/Auto2 [DPT_1.002 - 1bit] - 0-Manual; 1-Auto2
- 20 Control_ Vanes U-D Man/Auto3 [DPT_1.002 - 1bit] - 0-Manual; 1-Auto3
- 70 Status_ Vanes U-D Man/Auto [DPT_1.002 - 1bit] - 0-Manual; 1-Auto
- 71 Status_ Vanes U-D Man/Auto2 [DPT_1.002 - 1bit] - 0-Manual; 1-Auto2
- 72 Status_ Vanes U-D Man/Auto3 [DPT_1.002 - 1bit] - 0-Manual; 1-Auto3

- If set to "**no**" the object will not be shown.
- If set to "**yes**" the *Control_ Lamas U-D Man/Auto(2,3)* y *Status_ Lamas U-D Man/Auto(2,3)* objects will appear.
 - When a "**1**" value is sent to the *Control_* communication object, Vanes Up-Down will be in Auto mode and the *Status_* object will return this value.
 - When a "**0**" value is sent to the *Control_* communication object, Vanes Up-Down will be in Manual mode and the *Status_* object will return this value.
- ⚠ **Important:** When activating Auto Mode in the indoor unit, this one will choose the best position available for the Vanes Up-Down. This position will not be shown either in the KNX bus or in the remote controller.
- ⚠ **Important:** Read the documentation of your indoor unit to check how many AUTO modes are available.

4.5.6 Enable use of bit-type Vane U-D objects (for Control)

This parameter shows/hides the bit-type *Control_ Vanes U-D* objects.

- 21 Control_ Vanes U-D Pos 1 [DPT_1.002 - 1bit] - 1-Set Position 1
- 22 Control_ Vanes U-D Pos 2 [DPT_1.002 - 1bit] - 1-Set Position 2
- 23 Control_ Vanes U-D Pos 3 [DPT_1.002 - 1bit] - 1-Set Position 3
- 24 Control_ Vanes U-D Pos 4 [DPT_1.002 - 1bit] - 1-Set Position 4

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Control_ Vanes U-D* objects for each Position will appear. To activate a Vanes Position by using these objects, a **"1"** value has to be sent.

4.5.7 Enable use of bit-type Vane U-D objects (for Status)

This parameter shows/hides the bit-type *Status_ Vanes U-D* objects.

- 73 Status_ Vanes U-D Pos 1 [DPT_1.002 - 1bit] - 1-Vanes in Position 1
- 74 Status_ Vanes U-D Pos 2 [DPT_1.002 - 1bit] - 1-Vanes in Position 2
- 75 Status_ Vanes U-D Pos 3 [DPT_1.002 - 1bit] - 1-Vanes in Position 3
- 76 Status_ Vanes U-D Pos 4 [DPT_1.002 - 1bit] - 1-Vanes in Position 4

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Status_ Vanes U-D* objects for each Position will appear. When a Vanes Position is enabled, a **"1"** value is returned through its bit-type object.

4.5.8 Enable use of Text object for Vane U-D

This parameter shows/hides the *Status_ Vanes U-D Text* communication object.

- 77 Status_ Vanes U-D Text [DPT_16.001 - 14byte] - ASCII String

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Status_ Vanes U-D Text* object will appear. Also, in the parameters will be shown seven text fields, five for the Vane Position and one for the Auto function and another one for the Swing function, that will let modify the text string displayed by the *Status_ Vanes U-D Text* when changing a vane position.

> String when vanes U-D in AUTO	U-D AUTO
> String when vanes U-D in POS 1	U-D POS 1
> String when vanes U-D in POS 2	U-D POS 2
> String when vanes U-D in POS 3	U-D POS 3
> String when vanes U-D in POS 4	U-D POS 4

Figure 4.19 Parameter detail

4.6 Temperature Configuration dialog

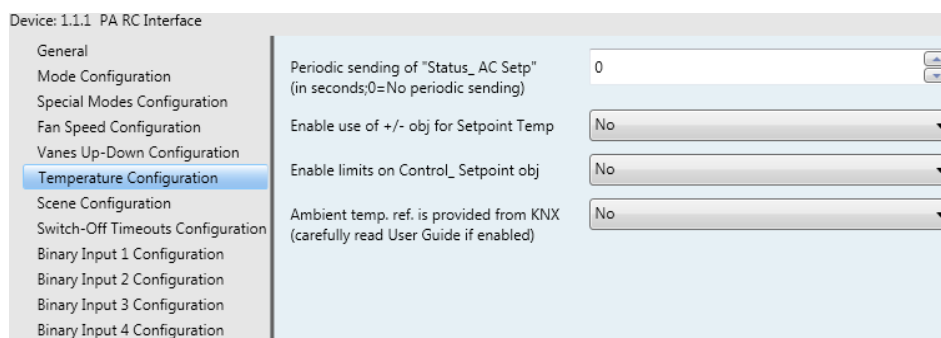


Figure 4.20 Default Temperature Configuration dialog

All the parameters in this section are related with the Temperature properties and communication objects.

4.6.1 Periodic sending of “Status_ AC Setp”

This parameter lets change the interval of time (in seconds, from 0 to 255) at the end of which the AC setpoint temperature is sent to the KNX bus. For a “0” value, the AC setpoint temperature will ONLY be sent on change. The AC setpoint temperature is sent through the communication object *Status_ AC Setpoint Temp*.




Figure 4.21 Parameter detail

⚠ Important: In case the ambient temperature is provided from KNX, the setpoint temperature returned from this object, will be the one resulting from the formula shown in the section “4.6.4 Ambient temp. ref. is provided from KNX”.

4.6.2 Enable use of +/- object for Setpoint Temp

This parameter shows/hides the *Control_ Setpoint Temp +/-* communication object which lets change the indoor unit setpoint temperature by using two different datapoint types.

27 Control_ Setpoint Temp +/- [DPT_1.007 - 1bit] - 0-Decrease;1-Increase

- If set to “no” the object will not be shown.
- If set to “yes” the *Control_ Setpoint Temp +/-* object and a new parameter will appear.





Figure 4.22 Parameter detail

➤ DPT type for +/- Setp Temp object

This parameter lets choose between the datapoints **0-Up / 1-Down [DPT_1.008]** and **0-Decrease / 1-Increase [DPT_1.007]** for the *Control_ Setpoint Temp +/-* object.

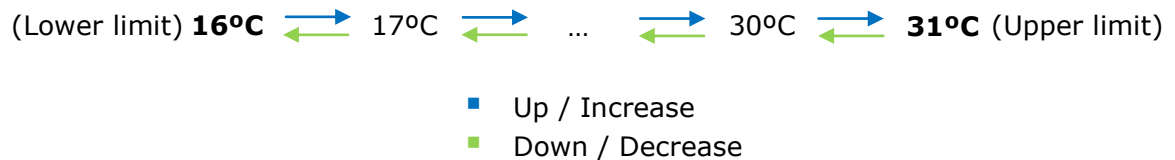

4.6.3 Enable limits on Control_ Setpoint obj

This parameter enables to define temperature limits for the *Control_ Setpoint Temperature* object.

Enable limits on Control_ Setpoint obj	Yes
> Lower limit (°C)	19.0 °C
> Upper limit (°C)	28.0 °C

Figure 4.23 Parameter detail

- If set to **"no"** the setpoint temperature limits for the *Control_ Setpoint Temperature* object will be the default: 16°C for the lower limit and 31°C for the upper limit.
- If set to **"yes"** it is possible to define temperature limits for the *Control_ Setpoint Temperature* object.

➤ Control_ Set Temp Lower limit (°C)

This parameter lets to define the lower limit for the setpoint temperature.

➤ Control_ Set Temp Upper limit (°C)

This parameter lets to define the upper limit for the setpoint temperature.

- ⚠ **Important:** If a setpoint temperature above the upper defined limit (or below the lower defined limit) is sent through the *Control_ Setpoint Temperature* object, it will be ALWAYS applied the limit defined.
- ⚠ **Important:** When limits are enabled, any setpoint temperature sent to the AC (even through scenes, special modes, etc.) will be limited.

4.6.4 Ambient temp. ref. is provided from KNX

This parameter shows/hides the *Control_ Ambient Temperature* communication object which lets use an ambient temperature reference provided by a KNX device.

28 Control_Ambient Temperature [DPT_9.001 - 2byte] - (°C)

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Control_Ambient Temperature* object will appear. Meant to be enabled when you want the temperature provided by a KNX sensor to be the reference ambient temperature for the air conditioner. Then, the following formula applies for calculation of real *Control_Setpoint Temperature* sent to the AC unit:

$$\text{"AC Setp. Temp."} = \text{"KNX Setp. Temp."} - (\text{"KNX Amb. Temp."} - \text{"KNX Setp. Temp."})/2$$

- AC Setp. Temp.: AC indoor unit setpoint temperature
- KNX Amb. Temp.: Ambient temperature provided from KNX
- KNX Setp. Temp.: Setpoint temperature provided from KNX

As an example, consider the following situation:

User wants: **19°C** ("KNX Setp. Temp.")

User sensor (a KNX sensor) reads: **21°C** ("KNX Amb Temp.")

In this example, the final setpoint temperature that DK-AC-KNX-1i will send out to the indoor unit (shown in "AC Setp. Temp.") will become $19^{\circ}\text{C} - (21^{\circ}\text{C} - 19^{\circ}\text{C})/2 = \mathbf{18^{\circ}\text{C}}$. This is the setpoint that will actually be requested to Daikin unit.

This formula will be applied as soon as the *Control_Setpoint Temperature* and *Control_Ambient Temperature* objects are written at least once from the KNX installation. After that, they are kept always consistent.

Note that this formula will always drive the AC indoor unit demand in the *right* direction, regardless of the operation mode (Heat, Cool or Auto).

4.7 Scene Configuration dialog

Parameter	Value
Enable use of scenes	Yes
Scenes can be stored from KNX bus	No
Enable use of bit objects for scene execution	No
Scene 1 preset	No
Scene 2 preset	No
Scene 3 preset	No
Scene 4 preset	No
Scene 5 preset	No

Figure 4.24 Parameter detail

All the parameters in this section are related with the Scene properties and communication objects. A scene contains values of: On/Off, Mode, Fan speed, Vane position, Setpoint Temperature and Remote Controller Disablement.

4.7.1 Enable use of scenes

This parameter shows/hides the scene configuration parameters and communication objects.





Figure 4.25 Parameter detail

- If set to **"no"** the scene parameters and communication objects will not be shown.
- If set to **"yes"** the scene parameters and communication objects will be shown. To execute a scene through the byte-type object, a value from **"0"** to **"4"** has to be sent, corresponding each one to a different scene (i.e. "0" = Scene 1;... "4" = Scene 5).

4.7.2 Scenes can be stored from KNX bus

This parameter shows/hides the *Control_ Save/Exec Scene* and all the *Control_ Store Scene* (if enabled) communication objects.

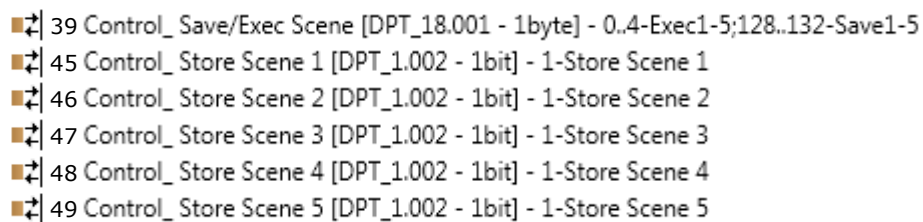

- If set to **"no"** the communication objects will not be shown.
- If set to **"yes"** the communication objects and a new parameter will appear. To store a scene through the byte-type object, a value from **"128"** to **"132"** has to be sent to the object, corresponding each one to a different scene (i.e. "128" = Scene 1;... "132" = Scene 5).




Figure 4.26 Parameter detail

➤ Enable use of bit objects for storing scenes (from bus)

If set to **"no"** the objects will not be shown.

If set to **"yes"** the *Control_ Store Scene* objects for storing scenes will appear. To store a scene by using these objects, a **"1"** value has to be sent to the scene's object we want to store (i.e. to store scene 4, a "1" has to be sent to the *Control_ Store Scene 4* object).

4.7.3 Enable use of bit objects for scene execution

This parameter shows/hides the *Control_ Execute Scene* bit-type communication objects.

- 45 Control_ Execute Scene 1 [DPT_1.002 - 1bit] - 1-Execute Scene 1
- 46 Control_ Execute Scene 2 [DPT_1.002 - 1bit] - 1-Execute Scene 2
- 47 Control_ Execute Scene 3 [DPT_1.002 - 1bit] - 1-Execute Scene 3
- 48 Control_ Execute Scene 4 [DPT_1.002 - 1bit] - 1-Execute Scene 4
- 49 Control_ Execute Scene 5 [DPT_1.002 - 1bit] - 1-Execute Scene 5

Enable use of bit objects for scene execution yes

Figure 4.27 Parameter detail

- If set to **"no"** the communication objects will not be shown.
- If set to **"yes"** the communication objects will appear. To execute a scene by using these objects, a **"1"** value has to be sent to the scene's object we want to execute (i.e. to execute scene 4, a **"1"** has to be sent to the *Control_ Execute Scene 4* object).

4.7.4 Scene "x" preset

This parameter lets define a preset for a scene (the following description is valid for all the scenes).

Scene 1 preset yes (scene will NOT be modifiable from KNX bus)

Figure 4.28 Parameter detail

- If set to **"no"** the preset for the scene "x" will be disabled.
- If set to **"yes"** the preset will be enabled. When a scene is executed the values configured in the preset will be applied.

⚠ Important: If a scene's preset is enabled, will not be possible to modify (store) the scene from the KNX bus.

> Scene 1 / Value for On-Off	ON
> Scene 1 / Value for Mode	COOL
> Scene 1 / Value for Fan Speed	FAN SPEED AUTO
> Scene 1 / Value for Vanes U-D (if available)	(unchanged)
> Scene 1 / Value for Setpoint Temp	18.0 °C
> Scene 1 / Value for Remote Lock	Locked (remote not allowed)

Figure 4.29 Parameter detail

➤ Scene "x" / Value for On-Off

This parameter lets choose the power of the indoor unit when the scene is executed. The following options are available: **"ON"**, **"OFF"** or **"(unchanged)"**.

➤ Scene "x" / Value for Mode

This parameter lets choose the mode of the indoor unit when the scene is executed. The following options are available: **"AUTO"**, **"HEAT(if available)"**, **"COOL"**, **"FAN"**, **"DRY"**, or **"(unchanged)"**.

➤ Scene "x" / Value for Fan Speed

This parameter lets choose the fan speed of the indoor unit when the scene is executed. The following options are available: **"FAN SPEED 1"**, **"FAN SPEED 2"**, **"FAN SPEED 3"**, or **"(unchanged)"**.

➤ Scene "x" / Value for Vane U-D (if available)

This parameter lets choose the vane position of the indoor unit when the scene is executed. The following options are available: **"VANES U-D POS 1"**, **"VANES U-D POS 2"**, **"VANES U-D POS 3"**, **"VANES U-D POS 4"**, **"VANES U-D SWING"** or **"(unchanged)"**.

➤ Scene "x" / Value for Setp Temp (°C)

This parameter lets choose the setpoint temperature of the indoor unit when the scene is executed. The following options are available: from **"16°C"** to **"31°C"** (both included), or **"(unchanged)"**.

➤ Scene "x" / Value for Remote Lock

This parameter lets choose the remote controller status of the indoor unit when the scene is executed. The following options are available: **"locked"**, **"unlocked"**, or **"(unchanged)"**.

⚠ **Important:** If any preset value is configured as **"(unchanged)"**, the execution of this scene will not change current status of this feature in the AC unit.

⚠ **Important:** When a scene is executed, *Status_ Current Scene* object shows the number of this scene. Any change in previous items does *Status_ Current Scene* show **"No Scene"**. Only changes on items marked as **"(unchanged)"** will not disable current scene.

4.8 Switch-Off Timeouts Configuration dialog

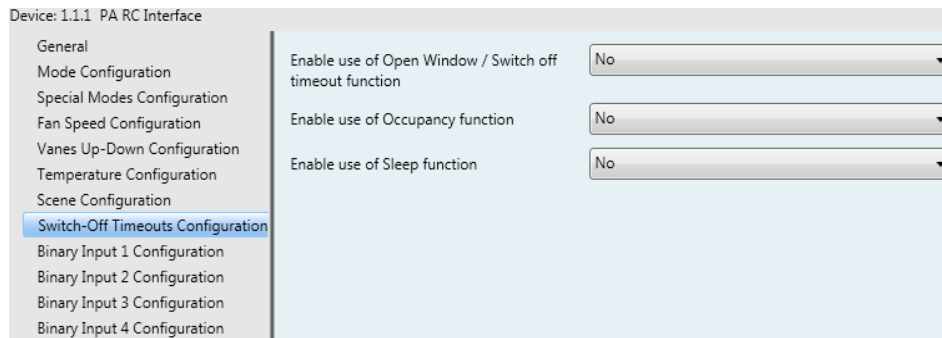


Figure 4.30 Default Switch-Off Timeouts Configuration dialog

All the parameters in this section are related with the timeout properties and communication objects.

4.8.1 Enable use of Open Window / Switch off timeout function

This parameter shows/hides the *Control_ Switch Off Timeout* communication object which lets Start/Stop a timeout to switch off the indoor unit.

30 Control_ Switch Off Timeout [DPT_1.010 - 1bit] - 0-Stop;1-Start
 30 Control_ Window Contact Status [DPT_1.009 - 1bit] - 0-Open;1-Closed

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Control_ Switch Off Timeout* object and new parameters will appear. If a **"1"** value is sent to this object, and the indoor unit is already turned on, the switch-off timeout will begin. If a **"0"** value is sent to this object, the switch-off timeout will stop.

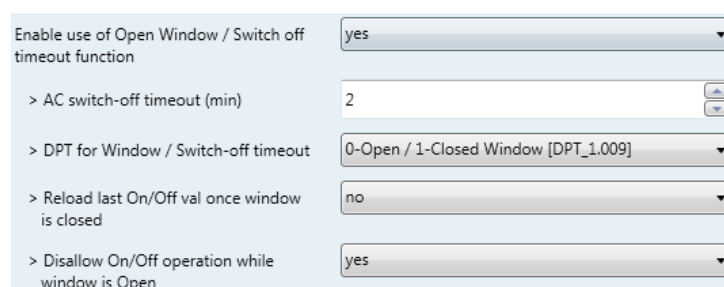


Figure 4.31 Parameter detail

➤ AC switch-off timeout (min)

This parameter lets select how much time (in minutes) to wait before switching off the indoor unit.

➤ DPT for Window / Switch-off timeout

This parameter lets choose between the datapoints **0-Open / 1-Closed Window [DPT_1.009]** and **0-Stop / 1-Start Timeout [DPT_1.010]** for the *Control_Switch Off Timeout*.

➤ Disallow On/Off operation while window is Open

If set to **"no"**, On/Off commands while the window is open will be accepted.

- If a **"1"** value is sent to the *Control_Switch Off Timeout* object the switch-off timeout period will begin again.
- If a **"0"** value is sent to the *Control_Switch Off Timeout* object, no action will be performed.

If set to **"yes"**, On/Off commands, while the window is open, will be saved (but not applied). These commands will be used in the next parameter if set to **"yes"**.

➤ Reload last On/Off val once window is closed?

If set to **"no"**, once the switch-off timeout is stopped, any value will be reloaded.

If set to **"yes"**, once the switch-off timeout is stopped, the last On/Off value sent will be reloaded.

- If a **"1"** value is sent to the *Control_Switch Off Timeout* object after the timeout period, the indoor unit will **turn on**.
- If a **"0"** value is sent to the *Control_Switch Off Timeout* after the timeout period, no action will be performed.

4.8.2 Enable use of Occupancy function

This parameter shows/hides the *Control_Occupancy* communication object which lets apply different parameters to the indoor unit depending on the presence/no presence in the room.

➤ 31 Control_Occupancy [DPT_1.018 - 1bit] - 0-Not Occupied;1-Occupied

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Control_Occupancy* object and new parameters will appear. If a **"1"** value is sent to this object (no room occupancy), the timeout will begin. If a **"0"** value is sent to this object, the timeout will stop.

Enable use of Occupancy function	yes
> Timeout to apply action (minutes)	2
> Action after timeout elapsed	Apply Preset Delta

Figure 4.32 Parameter detail

➤ Timeout to apply action (minutes)

This parameter lets choose how much time to wait (in minutes) before executing the action specified in the next parameter ("Action after timeout elapsed").

➤ Action after timeout elapsed

When **Switch-Off** is selected, once the timeout has elapsed, the indoor unit will be turned off.

When **Apply Preset Delta** is selected, once the timeout has elapsed, a delta temperature will be applied in order to save energy (decreasing the setpoint when in Heat mode, or increasing the setpoint when in Cool mode). Also new parameters will appear.

> Temp delta decrease (HEAT) or increase (COOL) (°C)	2.0°C
> Enable secondary timeout	yes

Figure 4.33 Parameter detail

➤ Temp delta decrease (HEAT) or increase (COOL) (°C)

This parameter lets configure the delta temperature (increase or decrease) that will be applied when the timeout has elapsed.

⚠ Important: When there is occupancy again after the application of a delta, the same delta will be applied inversely. (i.e. In a room with AC in cool mode and 25°C setpoint temperature, a **+2°C** delta is applied after the occupancy timeout, setting the setpoint at 27°C because there is no occupancy in the room. If the setpoint is raised to 29°C during that period, when the room is occupied again, a **-2°C** delta will be applied and the final setpoint temperature will then be 27°C).

➤ Enable secondary timeout

If set to **"no"** nothing will be applied.

If set to **"yes"**, a new timeout will be enabled and two new parameters will appear.

> Timeout to apply action (min)	2
> Action after timeout elapsed	Apply Preset Delta
> Temp delta dec (HEAT) / or inc (COOL) (°C)	2.0°C

Figure 4.34 Parameter detail

➤ Timeout to apply action (minutes)

This parameter lets choose how much time to wait (in minutes) before executing the action specified in the next parameter ("Action after timeout elapsed").

➤ Action after timeout elapsed

When **Switch-Off** is selected, once the timeout has elapsed, the indoor unit will turn off.

When **Apply Preset Delta** is selected, once the timeout configured is extinguished, a delta temperature will be applied (decreasing the setpoint when in Heat mode, or increasing the setpoint when in Cool mode). Also new parameters will appear.

➤ Temp delta decrease (HEAT) or increase (COOL) (°C)

This parameter lets configure the delta temperature that will be applied when the timeout is extinguished.

⚠ Important: When there is occupancy again after the application of a delta, the same delta will be applied inversely as explained above.

➤ Disallow On/Off operation while not Occupied

If set to **"no"**, On/Off commands while the window is open will be accepted.

- If a **"1"** value is sent to the *Control_ Occupancy* object the switch-off timeout period will begin again.
- If a **"0"** value is sent to the *Control_ Occupancy* object, no action will be performed.

If set to **"yes"**, On/Off commands while not occupied will be saved (but not applied). These commands will be used in the next parameter if set to **"yes"**.

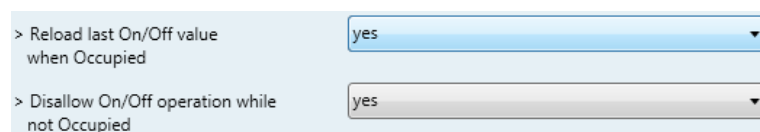


Figure 4.35 Parameter detail

➤ Reload last On/Off value when Occupied

If set to **"no"**, once the switch-off timeout has elapsed, any value will be reloaded.

If set to **"yes"**, once the switch-off timeout has elapsed, the last On/Off value will be reloaded.

- If a "1" value is sent to the *Control_ Occupancy* object after the timeout period, the indoor unit will **turn on**.
- If a "0" value is sent to the *Control_ Occupancy* after the timeout period no action will be performed.

4.8.3 Enable use of SLEEP timeout

This parameter shows/hides the *Control_ Sleep Timeout* communication object which lets start a timeout to automatically turn off the indoor unit.

➡ 32 Control_ Sleep Timeout [DPT_1.010 - 1bit] - 0-Stop;1-Start

- If set to "no" the object will not be shown.
- If set to "yes" the *Control_ Sleep Timeout* object and a new parameter will appear. If a "1" value is sent to this object the switch-off timeout will begin. If a "0" value is sent to this object, the switch-off timeout will stop.

Enable use of SLEEP timeout: yes

> Sleep function switch-off timeout (minutes): 1

Figure 4.36 Parameter detail

➤ Timeout to apply action (minutes)

This parameter lets select how much time (in minutes) to wait before switching off the AC unit.

4.9 Binary Input "x" Configuration dialog

Device: 1.1.1 PA RC Interface

General

Mode Configuration

Special Modes Configuration

Fan Speed Configuration

Vanes Up-Down Configuration

Temperature Configuration

Scene Configuration

Switch-Off Timeouts Configuration

Binary Input 1 Configuration

Binary Input 2 Configuration

Binary Input 3 Configuration

Binary Input 4 Configuration

Enable use of Input 1: Yes

> Contact type: NO: Normally Open

> Debounce time: 50 ms

> Disabling function: No

> Function: Switching

> Send telegram after bus recovery: No action

> Value on raising edge (contact activated): No action

> Value on falling edge (contact deactivated): No action

> Cyclical sending: Never

Figure 4.37 Binary Input Configuration dialog

All the parameters in this section are related with the binary inputs properties and communication objects.

4.9.1 Enable use of Input “x”

This parameter enables the use of the Input “x” and shows/hides the *Status_ Inx* communication object(s) which will act as configured in the “Function” parameter.

- 89 Status_ In1 - Switching [DPT_1.001 - 1bit] - 0-Off;1-On
- 91 Status_ In2 - Switching [DPT_1.001 - 1bit] - 0-Off;1-On
- 93 Status_ In3 - Switching [DPT_1.001 - 1bit] - 0-Off;1-On
- 95 Status_ In4 - Switching [DPT_1.001 - 1bit] - 0-Off;1-On

- If set to **“no”** the objects will not be shown.
- If set to **“yes”** the *Status_ Inx* object(s) and new parameters will appear.

4.9.2 Contact type

This parameter lets choose the behavior that will have the binary input depending on if the contact is normally open or normally closed.

- There are two possible options to configure the contact type: **“NO: Normally Open”** and **“NC: Normally Closed”**.

4.9.3 Debounce time

This parameter lets choose a debounce time (in milliseconds) that will be applied to the contact.

4.9.4 Disabling function

This parameter shows/hides the *Control_ Disable Input x* communication object which will let disable/enable the input x.

- 50 Control_ Disable Input 1 [DPT_1.003 - 1bit] - 0-Disable;1-Enable;
- 50 Control_ Disable Input 1 [DPT_1.002 - 1bit] - 0-Enable;1-Disable

- If set to **“no”** any object will be shown.
- When **“DPT 1.003: 0-Disable; 1-Enable”** is selected, the input can be disabled using the value **“0”** and enabled using the value **“1”**.
- When **“DPT 1.002: 0-Enable; 1-Disable”** is selected, the input can be disabled using the value **“1”** and enabled using the value **“0”**.

4.9.5 Function

This parameter lets choose the function that will have the binary input. There are 7 different functions available: Switching, Dimming, Shutter/Blind, Value, Execute Scene (internal), Occupancy (internal) and Window Contact (internal).

- When **"Switching"** is selected the communication object and new parameters for the Input "x" will appear as shown below.

89 Status_In1 - Switching [DPT_1.001 - 1bit] - 0-Off;1-On

> Function	Switching
> Send telegram after bus recovery	No action
> Value on raising edge (contact activated)	Toggle (On/Off)
> Value on falling edge (contact deactivated)	No action
> Cyclical sending	Never

Figure 4.38 Parameter detail

➤ Send telegram after bus recovery

This parameter lets select if the Binary Input "x" will send a telegram, or not, after a bus recovery, and the type of telegram sent (if enabled).

- When **"No action"** is selected, no telegram will be sent after a bus recovery.
- When **"Current status"** is selected, the binary input will send a telegram with its current status after a bus recovery. Also a new parameter will appear (see below).
- When **"On"** is selected, the binary input will send a telegram with a **"1"** value after a bus recovery. Also a new parameter will appear (see below).
- When **"Off"** is selected, the binary input will send a telegram with a **"0"** value after a bus recovery. Also a new parameter will appear (see below).

> Sending delay after bus recovery (seconds)	10
--	----

Figure 4.39 Parameter detail

➤ Sending delay after a bus recovery (seconds)

This parameter lets configure a delay (in seconds) that will be applied after a bus recovery and, after which, a telegram will be sent.

➤ Value on rising edge

This parameter lets select the value that the Binary Input "x" will send on a rising edge (contact activated).

- When **"On"** is selected, the binary input will always send telegrams with a **"1"** value.
- When **"Off"** is selected, the binary input will always send telegrams with a **"0"** value.
- When **"Toggle (On/Off)"** is selected, the binary input will send a **"1"** value after a **"0"** value and viceversa.
- When **"No action"** is selected, the binary input will not perform any action.

➤ Value on falling edge

This parameter lets select the value that the Binary Input "x" will send on a falling edge (contact deactivated).

- When **"On"** is selected, the binary input will always send telegrams with a **"1"** value.
- When **"Off"** is selected, the binary input will always send telegrams with a **"0"** value.
- When **"Toggle (On/Off)"** is selected, the binary input will send a **"1"** value after a **"0"** value and viceversa.
- When **"No action"** is selected, the binary input will not perform any action.

➤ Cyclical sending

This parameter lets enable/disable cyclical sending when a determined condition is met.

- When **"When output value is On"** is selected, everytime a **"1"** value is sent, it will be sent cyclically. Also a new parameter will appear (see below).
- When **"When output value is Off"** is selected, everytime a **"0"** value is sent, it will be sent cyclically. Also a new parameter will appear (see below).
- When **"Always"** is selected, the binary input will send any value cyclically. Also a new parameter will appear (see below).
- When **"Never"** is selected, cyclical sending will be disabled.

➤ Period for cyclical sending (seconds)


This parameter lets configure a time (in seconds) for the cyclical sending.



> Period for cyclical sending (seconds) 2

Figure 4.40 Parameter detail

- When **"Dimming"** is selected the communication objects and new parameters for the Input "x" will appear as shown below.

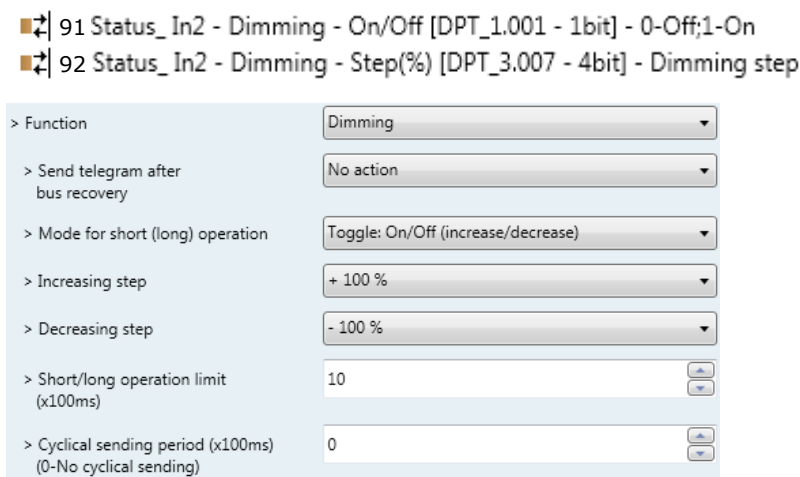

91 Status_In2 - Dimming - On/Off [DPT_1.001 - 1bit] - 0-Off;1-On
 92 Status_In2 - Dimming - Step(%) [DPT_3.007 - 4bit] - Dimming step


> Function Dimming
 > Send telegram after bus recovery No action
 > Mode for short (long) operation Toggle: On/Off (increase/decrease)
 > Increasing step + 100 %
 > Decreasing step - 100 %
 > Short/long operation limit (x100ms) 10
 > Cyclical sending period (x100ms) (0-No cyclical sending) 0

Figure 4.41 Parameter detail

➤ Send telegram after bus recovery

This parameter lets select if the Binary Input "x" will send a telegram, or not, after a bus recovery, and the type of telegram sent (if enabled).

- When **"No action"** is selected, no telegram will be sent after a bus recovery.
- When **"On"** is selected, the binary input will send a telegram with a **"1"** value after a bus recovery. Also a new parameter will appear (see below).
- When **"Off"** is selected, the binary input will send a telegram with a **"0"** value after a bus recovery. Also a new parameter will appear (see below).



> Sending delay after bus recovery (seconds) 10

Figure 4.42 Parameter detail

➤ Sending delay after a bus recovery (seconds)

This parameter lets configure a delay (in seconds) that will be applied after a bus recovery and, after which, a telegram will be sent.

➤ Mode for short (long) operation

This parameter lets select the value that the Binary Input "x" will send on a rising edge (contact activated), for a short and a long operation.

- When **"On (increase)"** is selected, the binary input will always send telegrams with a **"1"** value for a short operation, and an **"increase step"** for a long operation.
- When **"Off (decrease)"** is selected, the binary input will always send telegrams with a **"0"** value for a short operation, and an **"decrease step"** for a long operation.
- When **"Toggle: On/Off (increase/decrease)"** is selected:
 - For the short operation the binary input will send a **"1"** value after a **"0"** value and viceversa.
 - For the long operation the binary input will send an **"increase step"** after a **"decrease step"** and viceversa.

⚠ **Important:** Note that the first long operation in toggle depends on the last short operation, meaning that after a **"1"** value will be sent a **"decrease step"** and after a **"0"** value will be sent an **"increase step"**.

⚠ **Important:** The time period between a short and a long operation is defined in the parameter "Short/long operation limit (x100ms)".

➤ Increasing step

This parameter lets select the increasing step value (in %) that will be sent for a long operation.

➤ Decreasing step

This parameter lets select the decreasing step value (in %) that will be sent for a long operation.

➤ Short/long operation limit (x100ms)

This parameter lets introduce the time period difference for the short and the long operation.

➤ Cycl. send. period in long oper. (x100ms)

This parameter lets configure a time (in seconds) for the cyclical sending of a long operation.

- When **"Shutter/Blind"** is selected the communication objects and new parameters for the Input "x" will appear as shown below.

- 93 Status_In3 - Shut/Blind - Step [DPT_1.023 - 1bit] - 0-Step Up;1-Step Down
- 94 Status_In3 - Shut/Blind - Move [DPT_1.023 - 1bit] - 0-Move Up;1-Move Down

> Function	Shutter/Blind
> Send telegram after bus recovery	No action
> Operation	Toggle (Up/Down)
> Method	Step-Move-Step
> Short/long operation limit (x100ms)	10
> Vanes adjustment time (x100ms)	10

Figure 4.43 Parameter detail

➤ Send telegram after bus recovery

This parameter lets select if the Binary Input "x" will send a telegram, or not, after a bus recovery and the type of telegram sent (if enabled).

- When **"No action"** is selected, no telegram will be sent after a bus recovery.
- When **"Move Up"** is selected, the binary input will send a telegram with a **"0"** value after a bus recovery. Also a new parameter will appear (see below).
- When **"Move Down"** is selected, the binary input will send a telegram with a **"1"** value after a bus recovery. Also a new parameter will appear (see below).

> Sending delay after bus recovery (seconds)	10
--	----

Figure 4.44 Parameter detail

➤ Sending delay after a bus recovery (seconds)

This parameter lets configure a delay (in seconds) that will be applied after a bus recovery and, after which, a telegram will be sent.

➤ Operation

This parameter lets select the value that the Binary Input "x" will send on a rising edge (contact activated).

- When **"Up"** is selected, the binary input will always send telegrams with a **"0"**.
- When **"Down"** is selected, the binary input will always send telegrams with a **"1"** value.

- When **"Toggle (Up/Down)"** is selected the binary input will send a **"0"** value after a **"1"** value and viceversa.

➤ Method

This parameter lets select the working method for the shutter/blind.

- When **"Step-Move-Step"** is selected: On a rising edge (contact activated) a step/stop telegram will be sent and will begin a time called **T1**. If a falling edge occurs (contact deactivated) during the **T1**, no action will be performed.

If the rising edge is maintained longer than **T1**, a move telegram will be sent and will start a time called **T2**. If a falling edge occurs during the **T2**, a step/stop telegram will be sent. If a falling edge occurs after **T2** no action will be performed.

- When **"Move-Step"** is selected: On a rising edge a move telegram will be sent and will begin the **T2** time. If a falling edge occurs during the **T2**, a step/stop telegram will be sent. If a falling edge occurs after **T2** no action will be performed.

⚠ **Important:** The **T1** time have to be defined in the "Short/long operation limit (x100ms)" parameter. Also the **T2** time have to be defined in the "Vanes adjustment time (x100ms)" parameter.

➤ Short/long operation limit (x100ms)

This parameter lets introduce the time period difference for the short and the long operation (T1 time).

➤ Vanes adjustment time (x100ms)

This parameter lets introduce the time period for the vanes adjustment/blind movement (T2 time).

- When **"Value"** is selected the communication objects and new parameters for the Input "x" will appear as shown below.

➤ 95 Status_In4 - Value [DPT_5.010 - 1byte] - 1-byte unsigned value

> Function	Value
> Send telegram after bus recovery	Fixed value
> Sending delay after bus recovery (seconds)	10
> DPT to be sent	DPT 5.010 (1byte)
> Value on raising edge (when contact activated)	234

Figure 4.45 Parameter detail

➤ Send telegram after bus recovery

This parameter lets select if the Binary Input "x" will send a telegram, or not, after a bus recovery and the type of telegram sent (if enabled).

- When **"No action"** is selected, no telegram will be sent after a bus recovery.
- When **"Fixed value"** is selected, the binary input will send a telegram with the same value configured in the "Value on rising edge" parameter. Also a new parameter will appear (see below).



Figure 4.46 Parameter detail

➤ Sending delay after a bus recovery (seconds)

This parameter lets configure a delay (in seconds) that will be applied after a bus recovery and, after which, a telegram will be sent.

➤ DPT to be sent

This parameter lets select the DPT type for the value that will be defined in the next parameter. This value will be sent on a rising edge (contact activated).




Figure 4.47 Parameter detail

➤ Value on rising edge (when contact activated)

This parameter lets define a value for the DTP type configured in the "DPT to be sent" parameter. This value will be sent on a rising edge (contact activated).

- When **"Execute Scene (internal)"** is selected, the binary input "x" will activate the scene defined in the next parameter, on a rising edge (contact activated).




Figure 4.48 Parameter detail

➤ Scene when contact is activated

This parameter lets choose the scene that will be activated on a rising edge. This scene **MUST** be defined in the "Scene Configuration" dialog as a preset.

- When **"Occupancy (internal)"** is selected, the binary input "x" will have the same behavior as configured in the parameter "Enable use of Occupancy function" inside the "Switch-Off Timeouts Configuration" dialog.



Figure 4.49 Parameter detail


- When **"Window Contact (internal)"** is selected, the binary input "x" will have the same behavior as configured in the parameter "Enable use of Open Window / Switch off timeout function" inside the "Switch-Off Timeouts Configuration" dialog.



Figure 4.50 Parameter detail

5. Specifications

Envelope	ABS (UL 94 HB). 2,5 mm thickness
Dimensions	70 X 70 X 28 mm
Weight	70g
Colour	Ivory white
Power supply	29V DC, 7mA Supplied through KNX bus.
Panasonic A/B Bus	Voltage: 13-15V Current: 10mA
LED indicators	1 x KNX programming.
Push buttons	1 x KNX programming.
Binary inputs	4 x Potential-free binary inputs. Signal cable length: 5m unshielded, may be extended up to 20m with twisted. Compliant with the following standards: IEC61000-4-2 : level 4 - 15kV (air discharge) - 8kV (contact discharge) MIL STD 883E-Method 3015-7 : class3B
Configuration	Configuration with ETS.
Operating Temperature	From -25°C to 85°C
Storage Temperature	From -40°C to 85°C
Isolation Voltage	2500V
RoHS conformity	Compliant with RoHS directive (2002/95/CE).
Certifications	CE conformity to EMC directive (2004/108/EC) and Low-voltage directive (2006/95/EC) EN 61000-6-2; EN 61000-6-3; EN 60950-1; EN 50491-3; EN 50090-2-2; EN 50428; EN 60669-1; EN 60669-2-1

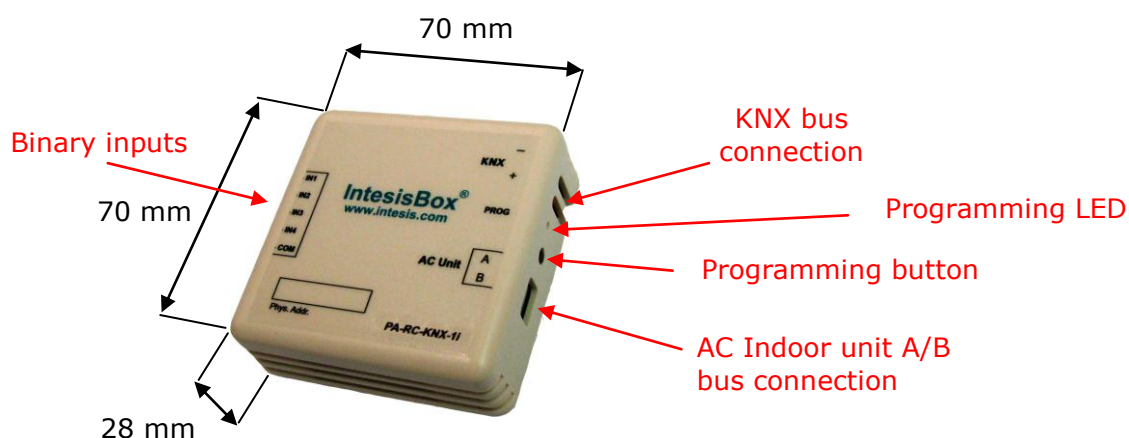

6. AC Unit Types compatibility.

A list of Panasonic indoor unit models compatible with PA-RC-KNX-1i and their available features can be found in:

http://www.intesis.com/pdf/IntesisBox_PA-RC-xxx-1_AC_Compatibility.pdf

7. Error Codes

RC Display	Error code KNX object	Location or problem	Check location
-	65535 (-1 if signed)	Error in the communication of PA-AC-KNX-1i device with the AC unit	Indoor/gateway connection wire
F15	1501	Drain level Float switch problem	Drain pump and drain pipe, indoor unit connectors
F16	1601	Louver switch problem	Louver motor, decorative panel connection terminal, or indoor unit louver motor connectors
F17	1701	D.C. Fan motor problem	Indoor unit D.C.Fan motor or connection terminals
F20	2001	Indoor temperature sensor problem	Indoor temperature sensor lead wire or indoor unit connector
	2010	Remote control thermistor problem	Remote control thermistor
F21	2101	Pipe temp. sensor problem (indoor unit)	Pipe temperature sensor lead wire or indoor unit connector
F26	2601	Remote control transmission problem	Remote control unit cable and connection terminals
F27	2701	Indoor/outdoor unit disconnection problem	Indoor/outdoor unit connection cable and connection terminals, or indoor unit power supplies (indoor side)
	2701	Indoor/outdoor unit connection error problem	Indoor/outdoor unit connection wire (indoor side)
	2701	Indoor/outdoor unit disconnection problem	Indoor/outdoor unit connection cable and connection terminals, or outdoor unit power supplies (outdoor side)
	2701	Indoor/outdoor unit connection error problem	Indoor/outdoor unit connection wire (outdoor side)
F30	3001	System problem	Total capacity for the number of indoor units is insufficient, or over. Check the total capacity and the number of indoor units
	3001	Open phase, or reversed phase of supply	Check the main power supply terminal board connections, or switch over any two of the power supply wires.
F31	3101	Suction pressure protection	Insufficient refrigerant or valve operation (closed)
	3101	High-pressure cut-off	Check the Refrigeration system
	3101	4 way valve problem	Check the 4 way valve or lead wire

	3101	Refrigerant system problem	Valve operation (closed), or refrigerant system
F32	3201	Compressor overcurrent protection	Open phase or lock in compressor
	3201	Compressor discharge temp. protection	Insufficient refrigerant
F40	4001	Outdoor heat exchanger outlet temperature sensor problem	Outdoor heat exchanger outlet temperature sensor (COND TEMP) lead wire, connector
	4001	Compressor discharge temperature sensor problem	Compressor discharge temperature sensor (DIS T. TEMP) lead wire, connector
F41	4101	High pressure switch open circuit problem	High-pressure switch lead wire, connector
	4101	Low pressure sensor problem	Low pressure sensor lead wire, connector or valve operation (closed)
F42	4201	Current detector open circuit Compressor internal protector worked	Outdoor unit current detector fault or connector Compressor fault or refrigeration system

In case you detect an error code not listed, contact your nearest Panasonic technical support service for more information on the error meaning.

Appendix A – Communication Objects Table

TOPIC	OBJECT NUMBER	NAME	LENGTH	DATAPOINT TYPE		FLAGS				FUNCTION
				DPT_NAME	DPT_ID	R	W	T	U	
On/Off	0	Control_ On/Off	1 bit	DPT_Switch	1.001		W	T		0 - Off; 1-On
Mode	1	Control_ Mode	1 byte	DPT_HVACContrMode	20.105		W	T		0 - Auto; 1 - Heat; 3 - Cool; 9 - Fan; 14 - Dry
	2	Control_ Mode Cool/Heat	1 bit	DPT_Heat/Cool	1.100		W	T		0 - Cool; 1 - Heat;
	3	Control_ Mode Cool & On	1 byte	DPT_Scaling	5.001		W	T		0% - Off; 0.1%-100% - On + Cool
	4	Control_ Mode Heat & On	1 byte	DPT_Scaling	5.001		W	T		0% - Off; 0.1%-100% - On + Heat
	5	Control_ Mode Auto	1 bit	DPT_Bool	1.002		W	T		1 - Auto
	6	Control_ Mode Heat	1 bit	DPT_Bool	1.002		W	T		1 - Heat
	7	Control_ Mode Cool	1 bit	DPT_Bool	1.002		W	T		1 - Cool
	8	Control_ Mode Fan	1 bit	DPT_Bool	1.002		W	T		1 - Fan
	9	Control_ Mode Dry	1 bit	DPT_Bool	1.002		W	T		1 - Dry
	10	Control_ Mode +/-	1 bit	DPT_Step	1.007		W			0 - Decrease; 1 - Increase
		Control_ Mode +/-	1 bit	DPT_UpDown	1.008		W			0 - Up; 1 - Down
Fan Speed	11	Control_ Fan Speed / 3 Speeds	1 byte	DPT_Scaling	5.001		W	T		0%-49% - Speed 1; 50%-82% - Speed 2; 83%-100% - Speed 3;

Fan Speed		Control_ Fan Speed / 3 Speeds	1 byte	DPT_Enumerated	5.010		W	T		1 - Speed 1; 2 - Speed 2; 3 Speed 3;
	12	Control_ Fan Speed Man/Auto	1 bit	DPT_Bool	1.002		W	T		0 – Manual; 1 - Auto
	13	Control_ Fan Speed 1	1 bit	DPT_Bool	1.002		W	T		1 – Set Fan Speed 1
	14	Control_ Fan Speed 2	1 bit	DPT_Bool	1.002		W	T		1 – Set Fan Speed 2
	15	Control_ Fan Speed 3	1 bit	DPT_Bool	1.002		W	T		1 – Set Fan Speed 3
	16	Control_ Fan Speed +/-	1 bit	DPT_Step	1.007		W			0 - Decrease; 1 - Increase
		Control_ Fan Speed +/-	1 bit	DPT_UpDown	1.008		W			0 - Up; 1 - Down
Vanes Up-Down	17	Control_ Vanes U-D / 4 pos	1 byte	DPT_Scaling	5.001		W	T		0%-37% - Pos1; 38%-62% - Pos2; 63%-87% Pos3; 88%-100% - Pos4;
		Control_ Vanes U-D / 4 pos	1 byte	DPT_Enumerated	5.010		W	T		1 - Pos1; 2 - Pos2; 3 - Pos3; 4 - Pos4;
	18	Control_ Vanes U-D Man/Auto	1 bit	DPT_Bool	1.002		W	T		0 – Manual; 1 - Auto
	19	Control_ Vanes U-D Man/Auto2	1 bit	DPT_Bool	1.002		W	T		0 – Manual; 1 – Auto2
	20	Control_ Vanes U-D Man/Auto3	1 bit	DPT_Bool	1.002		W	T		0 – Manual; 1 – Auto3
	21	Control_ Vanes U-D Pos1	1 bit	DPT_Bool	1.002		W	T		1 – Set Position 1
	22	Control_ Vanes U-D Pos2	1 bit	DPT_Bool	1.002		W	T		1 – Set Position 2
	23	Control_ Vanes U-D Pos3	1 bit	DPT_Bool	1.002		W	T		1 – Set Position 3
	24	Control_ Vanes U-D Pos4	1 bit	DPT_Bool	1.002		W	T		1 – Set Position 4
	25	Control_ Vanes U-D +/-	1 bit	DPT_Step	1.007		W			0 - Decrease; 1 - Increase

		Control_ Vanes U-D +/-	1 bit	DPT_UpDown	1.008		W		0 - Up; 1 - Down
Temperature	26	Control_ Setpoint Temperature	2 byte	DPT_Value_Temp	9.001		W	T	(°C)
	27	Control_ Setpoint Temp +/-	1 bit	DPT_Step	1.007		W		0 - Decrease; 1 - Increase
		Control_ Setpoint Temp +/-	1 bit	DPT_UpDown	1.008		W		0 - Up; 1 - Down
	28	Control_ Ambient Temperature	2 byte	DPT_Value_Temp	9.001		W	T	(°C)
Filter	29	Control_ Reset Filter	1 bit	DPT_Bool	1.015		W	T	1 - Reset filter
Timeout	30	Control_ Window Contact Status	1 bit	DPT_OpenClose	1.009		W	T	0 - Open; 1 - Closed
		Control_ Switch Off Timeout	1 bit	DPT_Start	1.010		W	T	0 - Stop; 1 - Start
	31	Control_ Occupancy	1 bit	DPT_Occupancy	1.018		W	T	0 - Not Occupied; 1 - Occupied
	32	Control_ Sleep Timeout	1 bit	DPT_Start	1.010		W	T	0 - Stop; 1 - Start
Locking	33	Control_ Lock Remote Control	1 bit	DPT_Bool	1.002		W	T	0 - Unlocked; 1 - Locked
	34	Control_ Lock Control Objects	1 bit	DPT_Bool	1.002		W	T	0 - Unlocked; 1 - Locked
Special Modes	35	Control_ Power Mode	1 bit	DPT_Start	1.010		W	T	0 - Stop; 1 - Start
	36	Control_ Econo Mode	1 bit	DPT_Start	1.010		W	T	0 - Stop; 1 - Start
	37	Control_ Additional Heat	1 bit	DPT_Start	1.010		W	T	0 - Stop; 1 - Start
	38	Control_ Additional Cool	1 bit	DPT_Start	1.010		W	T	0 - Stop; 1 - Start
Scenes	39	Control_ Save/Exec Scene	1 byte	DPT_SceneControl	18.001		W	T	0 to 4 - Exec. Scene 1 to 5; 128 to 132 - Save Scene 1 to 5
	40	Control_ Store Scene1	1 bit	DPT_Bool	1.002		W		1 - Store Scene
	41	Control_ Store Scene2	1 bit	DPT_Bool	1.002		W		1 - Store Scene

	42	Control_ Store Scene3	1 bit	DPT_Bool	1.002		W		1 - Store Scene
	43	Control_ Store Scene4	1 bit	DPT_Bool	1.002		W		1 - Store Scene
	44	Control_ Store Scene5	1 bit	DPT_Bool	1.002		W		1 - Store Scene
	45	Control_ Execute Scene1	1 bit	DPT_Bool	1.002		W	T	1 - Execute Scene
	46	Control_ Execute Scene2	1 bit	DPT_Bool	1.002		W	T	1 - Execute Scene
	47	Control_ Execute Scene3	1 bit	DPT_Bool	1.002		W	T	1 - Execute Scene
	48	Control_ Execute Scene4	1 bit	DPT_Bool	1.002		W	T	1 - Execute Scene
	49	Control_ Execute Scene5	1 bit	DPT_Bool	1.002		W	T	1 - Execute Scene
Disabling	50	Control_ Disable Input 1	1 bit	DPT_Bool	1.002		W	T	0 - Enable; 1 - Disable
		Control_ Disable Input 1	1 bit	DPT_Enable	1.003		W	T	0 - Disable; 1 - Enable
	51	Control_ Disable Input 2	1 bit	DPT_Bool	1.002		W	T	0 - Enable; 1 - Disable
		Control_ Disable Input 2	1 bit	DPT_Enable	1.003		W	T	0 - Disable; 1 - Enable
	52	Control_ Disable Input 3	1 bit	DPT_Bool	1.002		W	T	0 - Enable; 1 - Disable
		Control_ Disable Input 3	1 bit	DPT_Enable	1.003		W	T	0 - Disable; 1 - Enable
	53	Control_ Disable Input 4	1 bit	DPT_Bool	1.002		W	T	0 - Enable; 1 - Disable
		Control_ Disable Input 4	1 bit	DPT_Enable	1.003		W	T	0 - Disable; 1 - Enable
On/Off	54	Status_ On/Off	1 bit	DPT_Switch	1.001	R		T	0 - Off; 1-On
Mode	55	Status_ Mode	1 byte	DPT_HVACContrMode	20.105	R		T	0 - Auto; 1 - Heat; 3 - Cool; 9 - Fan; 14 - Dry
	56	Status_ Mode Cool/Heat	1 bit	DPT_Heat/Cool	1.100	R		T	0 - Cool; 1 - Heat
	57	Status_ Mode Auto	1 bit	DPT_Bool	1.002	R		T	1 - Auto

	58	Status_ Mode Heat	1 bit	DPT_Bool	1.002	R		T	1 - Heat
	59	Status_ Mode Cool	1 bit	DPT_Bool	1.002	R		T	1 - Cool
	60	Status_ Mode Fan	1 bit	DPT_Bool	1.002	R		T	1 - Fan
	61	Status_ Mode Dry	1 bit	DPT_Bool	1.002	R		T	1 - Dry
	62	Status_ Mode Text	14 byte	DPT_String_8859_1	16.001	R		T	ASCII String
Fan Speed	63	Status_ Fan Speed / 3 Speeds	1 byte	DPT_Scaling	5.001		W	T	33% - Speed 1; 67% - Speed 2; 100% - Speed 3;
		Status_ Fan Speed / 3 Speeds	1 byte	DPT_Enumerated	5.010		W	T	1 - Speed 1; 2 - Speed 2; 3 Speed 3;
	64	Status_ Fan Speed Manual/Auto	1 bit	DPT_Bool	1.002	R		T	0 – Manual; 1 - Auto
	65	Status_ Fan Speed 1	1 bit	DPT_Bool	1.002	R		T	1 – Fan is in speed 1
	66	Status_ Fan Speed 2	1 bit	DPT_Bool	1.002	R		T	1 – Fan is in speed 2
	67	Status_ Fan Speed 3	1 bit	DPT_Bool	1.002	R		T	1 - Fan is in Speed 3
	68	Status_ Fan Speed Text	14 byte	DPT_String_8859_1	16.001	R		T	ASCII String
Vanes Up-Down	69	Status_ Vanes U-D / 4 pos	1 byte	DPT_Scaling	5.001	R		T	25% - Pos1; 50% - Pos2; 75% - Pos3; 100% - Pos4;
		Status_ Vanes U-D / 4 pos	1 byte	DPT_Enumerated	5.010	R		T	1 - Pos1; 2 - Pos2; 3 - Pos3; 4 - Pos4;
	70	Status_ Vanes U-D Man/Auto	1 bit	DPT_Bool	1.002		W	T	0 – Manual; 1 - Auto
	71	Status_ Vanes U-D Man/Auto2	1 bit	DPT_Bool	1.002		W	T	0 – Manual; 1 – Auto2
	72	Status_ Vanes U-D Man/Auto3	1 bit	DPT_Bool	1.002		W	T	0 – Manual; 1 – Auto3
	73	Status_ Vanes U-D Pos1	1 bit	DPT_Bool	1.002	R		T	1 - Position 1

	74	Status_ Vanes U-D Pos2	1 bit	DPT_Bool	1.002	R		T	1 - Position 2
	75	Status_ Vanes U-D Pos3	1 bit	DPT_Bool	1.002	R		T	1 - Position 3
	76	Status_ Vanes U-D Pos4	1 bit	DPT_Bool	1.002	R		T	1 - Position 4
	77	Status_ Vanes U-D Text	14 byte	DPT_String_8859_1	16.001	R		T	ASCII String
Temperature	78	Status_ AC Setpoint Temp	2 byte	DPT_Value_Temp	9.001	R		T	(°C)
Filter	79	Status_ Filter Status	1 bit	DPT_Bool	1.002	R		T	0 - No Alarm; 1 - Alarm
Error	80	Status_ Error/Alarm	1 bit	DTP_Alarm	1.005	R		T	0 - No Alarm; 1 - Alarm
	81	Status_ Error Code	2 byte	Enumerated		R		T	0 - No Error; Any other see user's manual
	82	Status_ Error Text code	14 byte	DPT_String_8859_1	16.001	R		T	3 char MH Error; Empty - none
Special Modes	83	Status_ Power Mode	1 bit	DPT_Switch	1.001	R		T	0 - Off; 1-On
	84	Status_ Econo Mode	1 bit	DPT_Switch	1.001	R		T	0 - Off; 1-On
	85	Status_ Additional Heat	1 bit	DPT_Switch	1.001	R		T	0 - Off; 1-On
	86	Status_ Additional Cool	1 bit	DPT_Switch	1.001	R		T	0 - Off; 1-On
Counter	87	Status_ Operation Hour Counter	2 byte	DPT_Value_2_Ucount	7.001	R		T	Number of operating hours
Scene	88	Status_ Current Scene	1 byte	DPT_SceneNumber	17.001	R		T	0 to 4 - Scene 1 to 5; 63 - No Scene
Binary Inputs	89	Status_ Inx - Switching	1 bit	DPT_Switch	1.001	R		T	0 - Off; 1-On
	91	Status_ Inx - Dimming - On/Off	1 bit	DPT_Switch	1.001	R		T	0 - Off; 1 - On
	93	Status_ Inx - Shut/Blind - Step	1 bit	DPT_ShutterBlinds	1.023	R		T	0 - Step Up; 1 - Step Down
	95	Status_ Inx - Value	1 byte	DPT_Value_1_Ucount	5.010	R		T	1 byte unsigned value

	92	Status_ Inx – Value	2 byte	DPT_Value_2_Ucount	7.001	R		T		2 byte unsigned value
	94	Status_ Inx – Value	2 byte	DPT_Value_2_Count	8.001	R		T		2 byte signed value
	96	Status_ Inx – Value	2 byte	DPT_Value_Temp	9.001	R		T		Temperature (°C)
		Status_ Inx – Value	4 byte	DPT_Value_4_Ucount	12.001	R		T		4 byte unsigned value
		Status_ Inx – Dimming – Step(%)	1 bit	DPT_Control_Dimm.	3.007	R		T		Dimming step
		Status_ Inx - Shut/Blind -Move	1 bit	DPT_ShutterBlinds	1.023	R		T		0 – Move Up; 1 – Move Down